

Public-law institution jointly founded by the federal states and the Federation

European Technical Assessment Body
for construction products



European Technical Assessment

ETA-12/0327
of 19 July 2024

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

ED-BSP elements

Product family
to which the construction product belongs

Solid wood slab element to be used as a structural
element in buildings

Manufacturer

Eugen Decker Holzindustrie
GmbH & Co. KG
Hochwaldstraße 31
54497 Morbach
GERMANY

Manufacturing plant

Eugen Decker Holzindustrie
GmbH & Co. KG
Hochwaldstraße 31
54497 Morbach

This European Technical Assessment
contains

19 pages including 6 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 130005-00-0304

This version replaces

ETA-12/0327 issued on 28 August 2017

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

ED-BSP elements are plane cross laminated timber elements made of at least 3 crosswise (perpendicular) glued boards out of spruce, pine, Douglas fir or larch. The principle structure of the element is shown in Annex 1 and 2. Surfaces of the ED-BSP elements are planed. The cross-section of the elements is symmetric.

The layers are bonded together to the required thickness of the cross laminated timber.

Specifications of the used boards are given in Annex 2. Boards are visually or machine strength graded. Only technically dried wood is used.

The single boards of the cover layers meet at least strength class C24 according to EN 338 resp EN 14081-1, the single boards of the middle layers are to comply strength class C16 at least.

The thickness is 18 to 40 mm and the broadness 80 to 200 mm. For elements with ≥ 7 layers the cover layer and adjacent layer with the same grain direction meet at least strength class C24.

The boards have no grooves for load relieving.

Only boards which are planed on both sides of the outer layer are used. The boards may be connected by finger joints in longitudinal direction according to EN 14080. There are no butt joints. In elements adjacent layers may be arranged in the same direction as long as a symmetric, crosswise jointed cross-section remains.

The max. width of gaps between the single boards is given in Annex 2. The narrow sides of the boards are not glued.

The cross laminated timber elements are manufactured in accordance with the provisions of this European technical assessment using the automated manufacturing process as identified in the inspection of the plant by the Deutsches Institut für Bautechnik and laid down in the technical documentation.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The elements are intended to be used as load-bearing and/or stiffening or not load-bearing wall, ceiling/floor, roof and special construction components for timber structures. The solid wood slab element shall be subjected to static and quasi-static actions only.

The solid wood slab element is intended to be used in service classes 1 and 2 according to EN 1995-1-1.

Members shall be provided with an effective protection for the solid wood slab elements in service.

The performances given in Section 3 are only valid if the solid wood slab elements are used in compliance with the specifications and conditions given in Annex 1 to 5.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the solid wood slab element of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

Design

The suitability of the solid wood slab elements for the specified purpose is given under the following conditions:

- Design of the solid wood slab elements is carried out under the responsibility of an engineer experienced in such products.
- Design of the works shall account for the protection of the solid wood slab elements.
- The solid wood slab elements are installed correctly.

The design of the solid wood slab element can be performed according to EN 1995-1-1, taking into account Annexes 2 to 5 of the European Technical Assessment. Standards and regulations valid in the place of use shall be considered.

Packaging, transport, storage, maintenance and repair

The solid wood slab elements shall be protected during transport and storage against any damage and detrimental moisture effects. The manufacturer's instructions for packaging, transport and storage shall be observed.

The assessment of the fitness for use is based on the assumption that maintenance is not required during the assumed intended working life. In case of a severe damage of a solid wood slab element immediate actions regarding the mechanical resistance and stability of the works shall be initiated. Should this situation arise replacement of the elements can be necessary.

Installation

The manufacturer shall prepare assembling instructions in which the product-specific characteristics and important measures to be taken into consideration for assembling are described. The assembling instructions shall be available at every construction site.

The assembling of the solid wood slab elements according to this European Technical Assessment shall be carried out by appropriately qualified personnel.

Elements which are directly exposed to the weather shall be provided with an effective protection for the cross laminated timber element during assembling and service.

The safety-at-work and health protection regulations have to be observed.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability ¹⁾ (BWR 1)

Essential characteristic	Performance
Bending ²⁾	Annex 3
Tension and compression ²⁾	Annex 3
Shear ²⁾	Annex 3
Embedment strength	Annex 3
Creep and duration of the load	Annex 3
Dimensional stability	Annex 3
In-service environment	Annex 3
Bond integrity	Annex 3
¹⁾ This characteristic also relates to BWR 4. ²⁾ Load bearing capacity and stiffness regarding mechanical actions perpendicular to and in plane of the solid wood slab element.	

The adhesive for gluing the board layers and the finger joint connection of the individual boards fulfills the requirements for adhesive type I according to EN 15425.

Details on the adhesives and the bonding process are deposited with Deutsches Institut für Bautechnik.

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Annex 3
Resistance to fire	Annex 3

3.3 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	
Substance/s classified as EU-cat. Carc. 1A and/or 1B in accordance with Regulation (EC) No 1272/2008.	The product does not contain these dangerous substances.
Substance/s classified as EU-cat. Muta. 1A and/or 1B in accordance with Regulation (EC) No 1272/2008.	
Substance(s) classified as EU-cat. Acute Tox. 1, 2 and/or 3; substance(s) classified as EU-cat. Repr. 1A/1B; substance(s) classified as EU-cat. STOT SE 1 and/or STOT RE 1, in accordance with Regulation (EC) No 1272/2008.	
Formaldehyde emission	Formaldehyde class E1 in accordance with EN 13986
Water vapour permeability - Water vapour transmission	Annex 3
Use scenarios regarding BWR 3: IA 1, IA 2	

3.4 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Impact resistance	Annex 3

3.5 Protection against noise (BWR 5)

Essential characteristic	Performance
Airborne sound insulation	no performance assessed
Impact sound insulation	no performance assessed
Sound absorption	no performance assessed

3.6 Energy economy and heat retention (BWR 6)

Essential characteristic	Performance
Thermal conductivity	Annex 3
Air permeability	no performance assessed
Thermal inertia	Annex 3

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with EAD No. 130005-00-0304 the applicable European legal act is: 1997/176/EC amended by 2001/596/EC

The system to be applied is: 1




5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 19. Juli 2024 by Deutsches Institut für Bautechnik

Anja Dewitt
Head of Section

beglaubigt:
Deniz

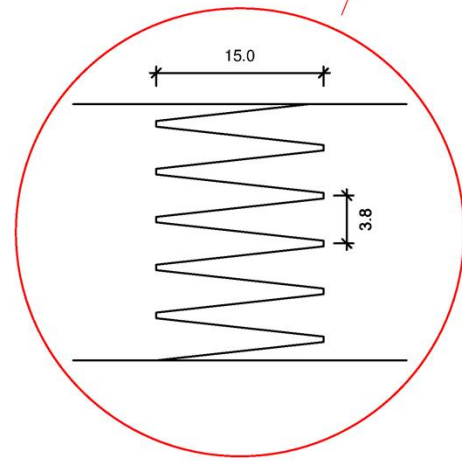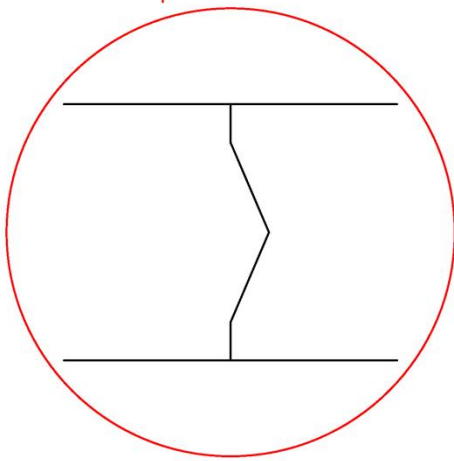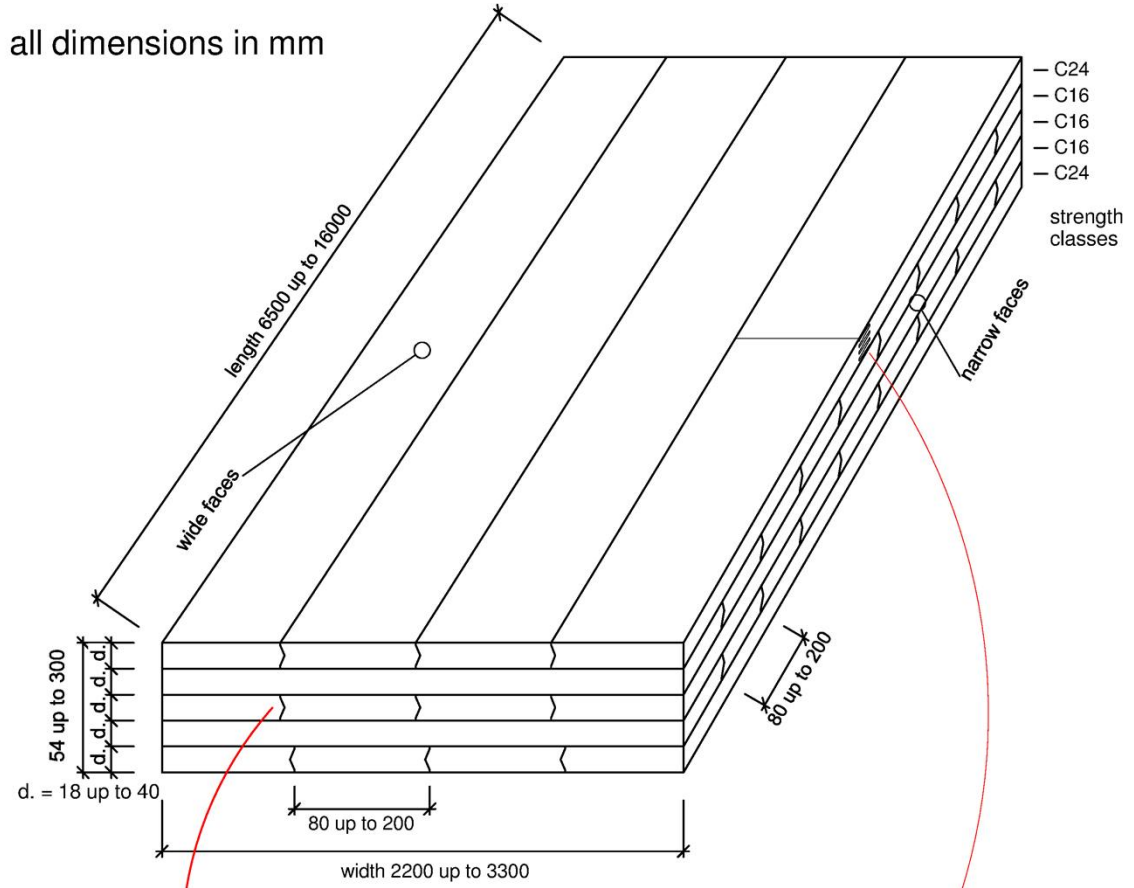

ED-BSP elements

Construction of a cross laminated timber element (Example)

Annex 1

Table 1: Dimensions and specifications of the elements

Characteristic	Specification
Elements	
Thickness	54 mm to 300 mm
Tolerance in thickness	± 1.0 mm
Width	≤ 3.30 m
Tolerance in width	± 3.0 mm
Length	≤ 16.00 m
Tolerance in length	± 3.0 mm
Number of layers	3 ≤ n ≤ 9
Number of consecutive layers having the same direction	≤ 2 for n > 5
Maximum width of gaps between the single boards	4 mm
Boards	
Material	Spruce, pine, Douglas fir, larch
Strength class according to EN 338 resp. EN 14081-1 - of the top layer and adjacent layer with the same grain direction with a number n ≥ 7 - of the middle layers	C24 ≥ C16
Thickness	18 mm to 40 mm
Width	80 mm to 200 mm
Ratio width to thickness of the cross layers	≥ 4 : 1
Moisture of wood according to EN 13183-2	12 % ± 2 %
Finger joints	acc. to EN 14080

ED-BSP elements

Dimensions and specifications of the cross laminated timber

Annex 2

Table 2: Essential requirements of the elements

BWR	Requirement	Verification method	Class / Use category / Value	
1	Mechanical resistance and stability			
	For the calculation of the individual layers the characteristic strength and stiffness values of softwood of the corresponding strength classes acc. to EN 338 shall be used taking into consideration the definitions in Annex 2. In addition the following values apply:			
	Mechanical actions in plane of cross laminated timber	Shear strength (5%-fractile)	$f_{v,k}$	See Annex 4, clause 1.4.1
	Mechanical actions perpendicular to the plane of cross laminated timber	Rolling shear strength (5%-fractile)	$f_{v,9090,k}$	1.0 N/mm ²
		Rolling shear modulus (mean value)	$G_{9090,mean}$	50 N/mm ²
	For references regarding the calculation see annex 4 and 5. National regulations might have to be followed.			
	Creep and duration of load	according to EN 1995-1-1		
	Dimensional stability	Moisture content during use shall not change to such extent that adverse deformations can occur.		
	Crack factor	according to EN 1995-1-1, 6.1.7: $k_{cr} = 1.0$		
	In-service environment	EN 1995-1-1	1 and 2	
Bond integrity	EAD 130005-00-0304	Passed		
2	Safety in case of fire			
	Reaction to fire			
	Timber elements except for floorings	Commission Decision 2005/610/EC	Euroclass D-s2, d0	
	Resistance to fire			
Charring rate	EN 1995-1-2	no performance assessed		
3	Hygiene, health and the environment			
	Water vapour permeability μ	EN ISO 10456	50 (dry) to 20 (wet)	
	Content of dangerous substances	EAD 130005-00-0304	See clause 3	
4	Safety in use			
	Impact resistance	Soft body resistance is assumed to be fulfilled for walls with a minimum of 3 layers and minimum thickness of 60 mm.		
5	Protection against noise			
	Airbourne sound insulation	no performance assessed		
	Impact sound insulation	no performance assessed		
	Sound absorption	no performance assessed		
6	Energy economy and heat retention			
	Thermal conductivity λ	EN ISO 10456	0.12 W/(m·K)	
	Air tightness	no performance assessed		
	Thermal inertia c_p	EN ISO 10456	1600 J/(kg ·K)	

ED-BSP elements

Essential requirements of the multilayered timber elements

Annex 3

1 Recommendations for the design of the elements (informative)

1.1 General

Design, calculation and realization may be performed according to EN 1995-1-1 taking into account the following provisions.

The determination of the distribution of stresses and internal forces must consider the influence of shear deformations of the cross layers. In Annex 5 advice is given on how to perform the calculation of the elements.

If using panels as cover, the deformation of the covers might have to be taken into account. These cover layers may not be used for calculation of the bearing capacity of the cross laminated timber elements.

For cross laminated timber elements under bending load with more than 5 layers it is necessary to use numerical solutions taking into account the shear deformation of the cross layers.

1.2 Characteristic values

The characteristic strength and stiffness values can be taken from Annex 2 and 3. In addition the following applies:

While calculating the part of the deformation due to shear forces, the element's thickness D regardless of the configuration and a shear modulus of $G = 60 \text{ N/mm}^2$ may be used.

1.3 Mechanical actions perpendicular to the element's plane

1.3.1 Bending and shear

For the calculation of the characteristic values of the element according to Annex 4, only the boards, which are oriented parallel to the span direction, may be considered.

For the verification of the bending strength of a layer the design value of the bending strength may be multiplied with a system factor k :

$$k = \min \begin{cases} 1 + 0.025 n \\ 1.1 \end{cases}$$

where n = number of adjacent boards

1.3.2 Tension and compression

The behaviour in bearing and deformation against compression perpendicular to the element's plane can be calculated according to EN 1995-1-1 using the strength and stiffness values given in chapter 1.2.

Tension loads perpendicular to plane of the element should be avoided.

ED-BSP elements

Essential requirements of the cross laminated timber (informative)

Annex 4

1.4 Mechanical actions in plane of the element

For loads in plane of the element only layers can be taken into account, where the direction of the grain is parallel to the stresses occurring from external loads.

1.4.1 Shear

Shear stresses may be calculated with the gross cross section.

These shear stresses are to be compared with an effective characteristic shear strength $f_{v,k}$ according to the following equation:

$$f_{v,k} = \min \left\{ \begin{array}{l} 3.5 \\ 8.0 \frac{D_{\text{net}}}{D} \\ 2.5 \frac{(n-1)(a^2 + b^2)}{6 D b} \end{array} \right. \quad \text{in [N/mm}^2\text{]}$$

where

D element thickness (see Annex 1)

D_{net} total thickness of longitudinal or cross layers within the element; the smaller value applies

n number of layers within the element, adjacent layers with parallel lamellae shall be considered as one layer and

a, b width of the boards in the longitudinal or cross layers, where $b > a$

(If a and b is unknown, the minimum value acc. to Table 1 must be applied.)

1.4.2 Tension and compression

The load-bearing and deformation behaviour in the element plane can be calculated according to EN 1995-1-1 using the strength and stiffness values given in chapter 1.2.

ED-BSP elements	Annex 4
Design considerations (informative)	

Design according to the theory of flexible bonded beams

The calculation of elements with up to five layers can be performed using the theory of flexible bonded beams as described in EN 1995-1-1.

To consider deformations due to shear the factor s_i/K_i according to the standard is substituted by the factor $\bar{h}_i/(G_R \cdot b)$.

The effective moment of inertia is calculated by:

$$I_{ef} = \sum_{i=1}^3 (I_i + \gamma_i \cdot A_i \cdot a_i^2) \quad \text{where} \quad A_i = b_i \cdot h_i; \quad I_i = \frac{b_i \cdot h_i^3}{12}$$

$$\gamma_1 = \frac{1}{1 + \frac{\pi^2 \cdot E_0 \cdot A_1 \cdot \bar{h}_1}{G_R \cdot b \cdot l^2}}; \quad \gamma_2 = 1; \quad \gamma_3 = \frac{1}{1 + \frac{\pi^2 \cdot E_0 \cdot A_3 \cdot \bar{h}_2}{G_R \cdot b \cdot l^2}}$$

$$a_1 = \left(\frac{h_1}{2} + \bar{h}_1 + \frac{h_2}{2} \right) - a_2; \quad a_3 = \left(\frac{h_2}{2} + \bar{h}_2 + \frac{h_3}{2} \right) + a_2$$

$$a_2 = \frac{\gamma_1 \cdot A_1 \cdot \left(\frac{h_1}{2} + \bar{h}_1 + \frac{h_2}{2} \right) - \gamma_3 \cdot A_3 \cdot \left(\frac{h_2}{2} + \bar{h}_2 + \frac{h_3}{2} \right)}{\sum_{i=1}^3 (\gamma_i \cdot A_i)}$$

The bending stress in the centre of the boards may be disregarded.

The governing bending stress in the outermost fibre of the boards:

$$\sigma_{m,r,i,d} = \pm \frac{M_d}{I_{ef}} \cdot \left(\gamma_i \cdot a_i + \frac{h_i}{2} \right) \leq f_{m,d}$$

Shear design is in the governing plane:

$$\tau_{v,d} = \frac{V_d \cdot \gamma_i \cdot S_i}{I_{ef} \cdot b} \leq f_{R,d}$$

Notation:

- h_{tot} = thickness of the whole element [mm]
- h_i = thickness of the layer i parallel to the direction of load transfer [mm]
- \bar{h}_i = thickness of the layer i perpendicular to the direction of load transfer [mm]
- b = width of the element [mm]
- n = number of layers
- l = span width [mm]
- I_{ef} = effective moment of inertia [Nmm²]
- G_R = rolling shear modulus [N/mm²]
- E_0 = modulus of elasticity parallel to the grain of the boards [N/mm²]

ED-BSP elements

Design considerations (informative)

Annex 4

2 Recommendations for the design of the fasteners (informative)

2.1 General

The determination of characteristic values of the load-bearing capacity of fasteners in the element shall be carried out according to EN 1995-1-1 or acc. to an European Technical Assessment which has been granted for the relevant fastener as for softwood or for glued laminated timber.

Wide faces are the surfaces of the element parallel to the plane of the element consisting of the surface of the outer layers.

Narrow faces are the lateral and the cross grain board surfaces perpendicular to the plane of the element.

Only fasteners according to EN 1995-1-1 or a European Technical Assessment may be used.

If the position of the fasteners in the narrow faces is not clearly defined (end grain, gaps between the single boards, etc.), then the most unfavorable case is to be assumed.

The grain direction of the cover layers governs the minimum spacings of the fasteners as well as the embedding strength is.

For the minimum spacings, minimum thicknesses, minimum layer thicknesses and minimum penetration length of fasteners, see Appendix 5.

Additional please note the following:

2.2 Nails

The nails must be at least 2.8 mm in diameter.

Wide faces

The characteristic load-carrying capacity of laterally loaded nails in the wide faces is to be determined according to EN 1995-1-1. Decisive for the minimum spacings is the grain direction of the cover layers. The characteristic density of the cover layers is decisive for the density.

The effective number of nails n_{ef} may be set equal to the actual number n .

Narrow faces

Nails in the narrow faces of the elements shall not be considered as load-bearing.

2.3 Screws

The outer thread diameter shall be used as the relevant diameter d of the screw. Penetration lengths $l_{ef} < 4 d$ should not be considered as load-carrying.

The minimum diameter for screws in the wide faces is 4 mm and in the narrow faces 6 mm.

Wide faces

The load direction must be perpendicular to the screw axis and parallel to the wide face of the cross laminated timber.

The embedding strength may be determined as for nails in solid timber according to DIN EN 1995-1-1 where the characteristic density of the cover layers is to be used.

Decisive for the minimum spacings is the grain direction of the cover layers.

The effective number of screws n_{ef} may be set equal to the actual number n .

ED-BSP elements	Annex 5
Fasteners (informative)	

Narrow faces

The load direction must be perpendicular to the screw axis and parallel to the narrow face of the cross laminated timber.

Regardless of the arrangement of the screw in the narrow face (e.g. for angles between screw axis and grain direction of $0^\circ \leq \alpha < 90^\circ$), the characteristic value of the embedding strength, when using screws without predrilling, shall be calculated as follows:


$$f_{h,k} = 20 \cdot d^{-0,5} \quad \text{in N/mm}^2$$

where

d nominal diameter of the screw in mm

The effective number of screws n_{ef} may be set as for bolts in solid timber according to DIN EN 1995-1-1.

Note: For actions perpendicular to the plane of the cross laminated timber the possibility of splitting caused by the tension force component perpendicular to the grain, shall be taken into account. Connections with ratios $h_{ef}/D \leq 0.7$ should be reinforced with fully threaded screws (see Figure).

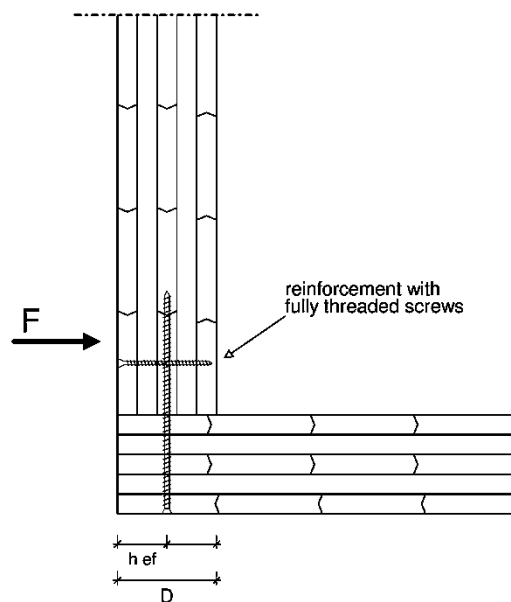

Axially loaded screws (pull-out)

The characteristic withdrawal capacity of a fastener in the wide face shall be carried out according to EN 1995-1-1 or acc. to a European Technical Assessment of the fastener.

Screws with an angles $\alpha < 15^\circ$ between the screw axis and the grain direction may be loaded only in the load duration classes "short" and "very short". This only applies to screws for which this direction of load is regulated in the European Technical Assessment of the screw.

Screws oriented parallel to the wide face of the cross laminated timber should be completely arranged within one board layer. The outer diameter of the threaded part should not exceed the thickness of the board layer the screw is arranged in.

The characteristic pull-through strength of the screw head is to be determined as for solid timber, depending on the characteristic density of the corresponding layer in the head area of the screw.

ED-BSP elements	Annex 5
Fasteners (informative)	

2.4 Split ring, shear plate and toothed-plate connectors

Wide faces

The characteristic load-carrying capacity of split ring, shear plate and toothed-plate connectors in the wide faces of cross laminated timber may be calculated according to EN 1995-1-1 for an angle between force and grain direction of $\alpha = 0^\circ$ regardless of the actual angle between the force and grain direction of the cover layers.

When inserting in the wide faces a minimum layer thickness of 18 mm must be maintained .

Narrow faces

For split ring and shear plate connectors in the narrow faces of the cross laminated timber the regulations for connections with split ring connectors in the end grain of timber members may be applied.

2.5 Connections with dowels and bolts

Wide faces

The characteristic load-carrying capacity of dowelled or bolted connections in the wide faces is to be determined with the embedding strength according to the following equation:

$$f_{h,\alpha,k} = \frac{32 \cdot (1 - 0.015 \cdot d)}{1.1 \cdot \sin^2 \alpha + \cos^2 \alpha} \quad \text{in N/mm}^2$$

where

d fastener diameter in mm

α angle between force and grain direction of the cover layer

Decisive for the calculation of the embedding strength is the grain direction of the cover layers.

For dowels and bolts connections with a diameter ≥ 10 mm, $n_{ef} = n$ may be assumed.

Narrow faces

The characteristic load-carrying capacity of dowelled or bolted connections in the narrow faces is to be determined with the embedding strength according to the following equation:

$$f_{h,k} = 9 \cdot (1 - 0.017 \cdot d) \quad \text{in N/mm}^2$$

where

d fastener diameter in mm

Note: For actions perpendicular to the plane of the cross laminated timber the possibility of splitting caused by the tension force component perpendicular to the grain, shall be taken into account. Connections with ratios $h_{ef}/D \leq 0.7$ should be reinforced with fully threaded screws.

ED-BSP elements	Annex 5
Fasteners (informative)	

3 Minimum spacings of fasteners (informative)


3.1 Minimum spacings of fasteners in the wide faces

Minimum spacings – parallel and perpendicular to grain




Edge and end distances

loaded end $a_{3,t}$

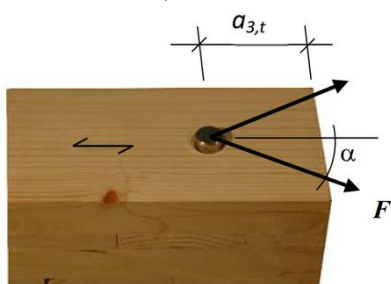

unloaded end $a_{3,c}$

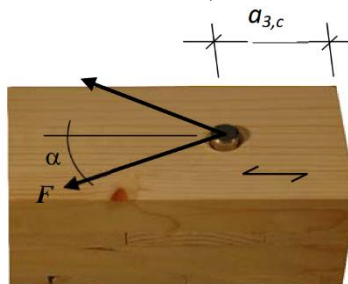

unloaded edge $a_{4,c}$

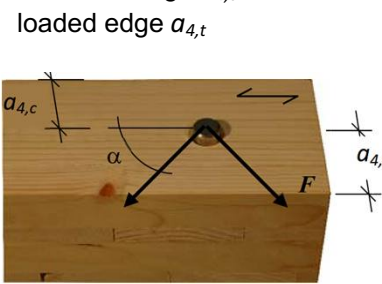


Table 3a: Minimum spacings of fasteners in the wide faces

fastener	a_1	a_2	$a_{3,t}$	$a_{3,c}$	$a_{4,t}$	$a_{4,c}$
screws ¹⁾	$4 \cdot d$	$2.5 \cdot d$	$6 \cdot d$	$6 \cdot d$	$6 \cdot d$	$2.5 \cdot d$
nails	$(3+3 \cdot \cos\alpha) \cdot d$	$3 \cdot d$	$(7+3 \cdot \cos\alpha) \cdot d$	$6 \cdot d$	$(3+4 \cdot \sin\alpha) \cdot d$	$3 \cdot d$
dowels	$(3+2 \cdot \cos\alpha) \cdot d$	$3 \cdot d$	$5 \cdot d$	$4 \cdot d \cdot \sin\alpha$ min. $3 \cdot d$	$3 \cdot d$	$3 \cdot d$
bolts	$(3+2 \cdot \cos\alpha) \cdot d$ min. $4 \cdot d$	$4 \cdot d$	$5 \cdot d$	$4 \cdot d \cdot \sin\alpha$ min. $4 \cdot d$	$3 \cdot d$	$3 \cdot d$
α	angle between force and grain direction of the cover layer					
¹⁾	self-tapping screws					

ED-BSP elements

Fasteners (informative)

Annex 5

3.2 Minimum spacings, minimum thicknesses, minimum layer thicknesses und minimum penetration lengths of fasteners in the narrow faces

The minimum spacings in the narrow faces are independent of the angle between fastener axis and grain direction.

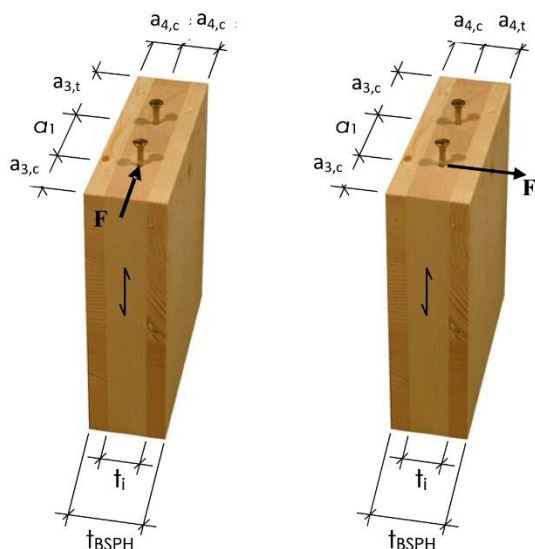


Table 3b: Minimum spacings of fasteners in the narrow faces

	a_1	a_2	$a_{3,t}$	$a_{3,c}$	$a_{4,t}$	$a_{4,c}$
screws ¹⁾	10·d	3·d	12·d	7·d	6·d	5·d
dowels	4·d	3·d	5·d	3·d	5·d	3·d
bolts	4·d	4·d	5·d	4·d	5·d	3·d
¹⁾ self-tapping screws						

Table 3c: Requirements for fasteners in the narrow faces of cross laminated timber

fastener	Minimum thickness of the cross laminated timber	Minimum thickness of the relevant layer	Minimum penetration length of the fastener t_1 oder t_2 ^{*)}
	t_{BSPH} in mm	t_i in mm	in mm
Screws ¹⁾	10·d	d > 8 mm: 3·d d ≤ 8 mm: 2·d	10·d
dowels bolts	6·d	d	5·d
^{*)} t_1 Minimum penetration length of the fastener in side members (member to be connected) t_2 Minimum penetration length of the fastener in middle members (cross laminated timber element) ¹⁾ self-tapping screws			

ED-BSP elements

Fasteners (informative)

Annex 5

Reference documents

- EAD 130005-00-0304, European Assessment Document for “Solid wood slab element to be used as a structural element in buildings”, Edition March 2015
- EN 14081-1:2019, Timber structures – Strength graded structural timber with rectangular cross section – Part 1: General requirements
- EN 14080:2013, Timber structures - Glued laminated timber and glued solid timber - Requirements
- EN 1995-1-1:2010 + A2:2014, Eurocode 5: Design of timber structures - Part 1-1: General - Common rules and rules for buildings
- EN 1995-1-2:2010, Eurocode 5 - Design of timber structures - Part 1-2: General - Structural fire design
- EN 15425:2017, Adhesives - One component polyurethane for load bearing timber structures - Classification and performance requirements
- EN 338:2016, Structural timber – Strength classes
- EN 13986:2015, Wood-based panels for use in construction – Characteristics, evaluation of conformity and marking
- EN 13183-2:2002, Moisture content of a piece of sawn timber – Part 2: Estimation by electrical resistance method
- EN ISO 10456:2010, Building materials and products – Hygrothermal properties – Tabulated design values and procedures for determining declared and design thermal values

ED-BSP elements	Annex 6
Reference documents	