

Public-law institution jointly founded by the federal states and the Federation

European Technical Assessment Body
for construction products



European Technical Assessment

ETA-18/0119
of 30 April 2024

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Hilti installation channel:

- MQ-41/3
- MQ-41/3 LL
- MQ-41 D
- MQ-21.5
- MQ-41
- MQ-41-L

Product family to which the construction product belongs

Products for installation systems for supporting technical building equipment

Manufacturer

Hilti AG
Feldkircherstraße 100
9494 Schaan
FÜRSTENTUM LIECHTENSTEIN

Manufacturing plant

L1000511

This European Technical Assessment contains

46 pages including 42 annexes which form an integral part of this assessment

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of

EAD 280016-00-0602 (Version 07/2020)

This version replaces

ETA-18/0119 issued on 26 June 2018

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

Objects of this European Technical Assessment are Hilti installation channels MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L. The Hilti installation channels MQ-41/3, MQ-41/3 LL, MQ-41, MQ-41-L and MQ-21.5 consist of thin-walled steel with parallel flanges and a connecting web. The flanges are turned at the end. The flanges of the channels MQ-41, MQ-41 D, MQ-41-L and MQ-21.5 are designed with an offset. The turned flange ends are designed with a toothed shape which makes it possible to force-fit the channels to specific channel system fixtures. Different recesses in the back of the channels in the form of oblong holes and round holes allow the use of fasteners and fixtures. The MQ-41 D installation channel consists of two profiles of similar type as MQ-41, which are connected in the area of the holes in the back of the channels in a shape-fitting and force-fitting way as a kind of riveted connection. The channels are delivered in lengths of 2 m, 3 m and 6 m for the channels MQ-41, MQ-41-L and MQ-21.5 and in lengths of 3 m or 6 m for the channels MQ-41/3, MQ-41/3 LL and MQ-41 D. The channels can be cut to length as required.

Annex A describes the dimensions and materials of the Hilti installation channels MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L.

2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performance given in Section 3 can only be assumed if the Hilti installation channels MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L are used in compliance with the specifications and under boundary conditions set out in Annex B. The test and assessment methods on which this European Technical Assessment is based lead to an assumption of a working life of the Hilti installation channels MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L of at least 50 years in final use under ambient temperatures in indoor areas. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

In accordance with the European Assessment Document EAD 280016-00-0602, the product is intended to be used for supporting

- a) Installations for the support of sprinkler kits
- b) Installations for the support of technical building equipment in general.
- c) c) installations for the support of pipes for the transport of water not intended for human consumption.
- d) installations for the support of pipes for the transport of gas/fuel intended for the supply of building heating/cooling systems

3 Performance of the product and references to the methods used for its assessment

3.1 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Pull-through resistance of channel back holes at elevated temperatures	see Annex D
Bending characteristics of the channel at elevated temperatures	see Annex D

3.2 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Shape	see Annex A
Dimensions	see Annex A
Material and cross-section characteristics	see Annex A
Characteristic pull-through resistance of channel back holes at ambient temperature	see Annex C

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with the European Assessment Document EAD 280016-00-0602, the following legal bases apply for assessment and verification of constancy of performance:

Intended use	System	Legal base, decision of EU-Commission
a) For the support of fire-fighting systems	1	96/577/EC, amended 2002/592/EC
b) For the support of technical building equipment in general	2+	97/161/EC
c) For supporting pipes for the transport of water not intended for human consumption	4	1999/472/EC, amended 2001/596/EC
d) For supporting pipes for the transport of gas/fuel intended for the supply of building heating/cooling systems	3	

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

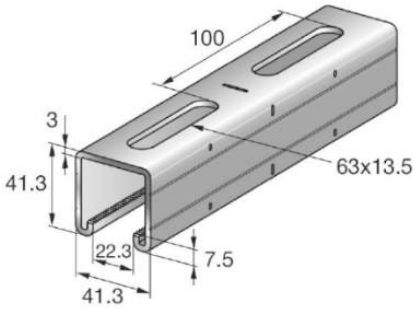
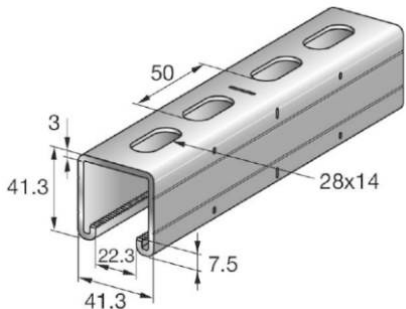
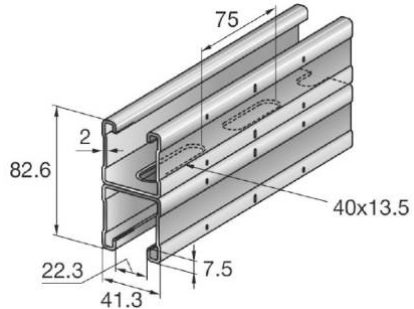
There are no details deposited.

Issued in Berlin on 30 April 2024 by Deutsches Institut für Bautechnik

Dr.-Ing. Ronald Schwuchow
Head of Department

beglaubigt:
Ascher

Table A1: Dimensions and materials of installation channels MQ-41/3, MQ-41/3 LL and MQ-41 D

Illustration ¹⁾	Item number	Designation	Length [m]	Materials and coatings
	369596	MQ-41/3 3M	3	S250GD+Z275-M-A-C in accordance with EN 10346
	369597	MQ-41/3 6M	6	
	2048102	MQ-41/3 3M LL	3	S250GD+Z275-M-A-C in accordance with EN 10346
	2048103	MQ-41/3 6M LL	6	
 <p>Two profiles of MQ-41 D channel are connected in the area of the holes in the back of the channels in a shape-fitting and force-fitting way as a kind of riveted connection.</p>	369603	MQ-41 D 3m	3	S250GD+Z275-M-A-C in accordance with EN 10346
	369604	MQ-41 D 6m	6	

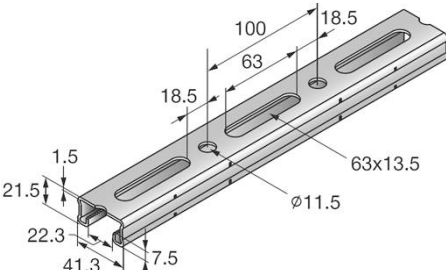
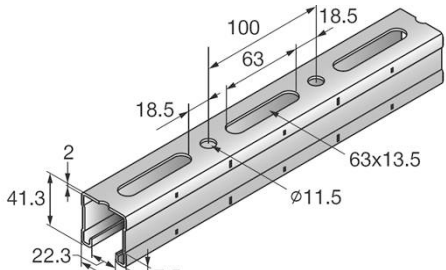
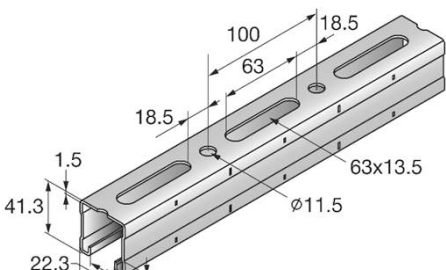
¹⁾ Dimensions in mm

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L

Product description
Dimensions and materials

Annex A1

Table A2: Dimensions and materials of installation channels MQ-21.5, MQ-41 and MQ-41-L

Illustration ²⁾	Item number	Designation	Length [m]	Materials and coatings
	2184773	MQ-21.5 6m	6	S280GD+Z140-M-A-C in accordance with EN 10346
	2184772	MQ-21.5 3m	3	
	2184771	MQ-21.5 2m	2	
	369592	MQ-41 6m	6	S250GD+Z275-M-A-C in accordance with EN 10346
	369591	MQ-41 3m	3	
	304559	MQ-41 2m	2	
	2141964	MQ-41-L 6m	6	S280GD+Z140-M-A-C in accordance with EN 10346
	2141965	MQ-41-L 3m	3	
	2141966	MQ-41-L 2m	2	

²⁾ Dimensions in mm

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L

Product description
Dimensions and materials

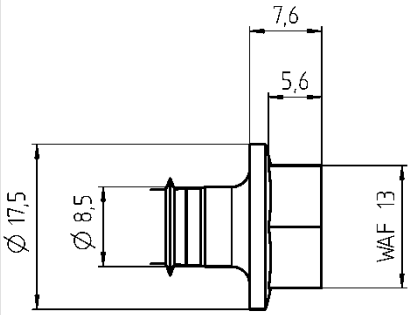
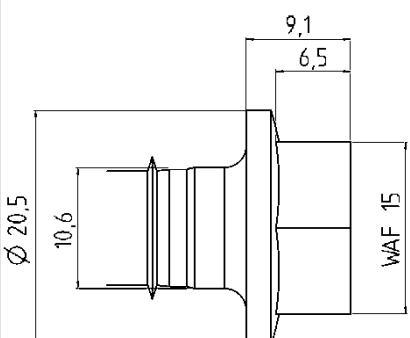
Annex A2

- Hilti MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L installation channels are used to transfer building services component loads such as ducts and equipment for sprinklers, water, heating, cooling, ventilation, electrical and other systems. Hilti MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L installation channels are performing this loadbearing function under the conditions described in Section 2 of this European Technical Assessment.
- Hilti MQ-41/3, MQ-41/3 LL, MQ-21.5, MQ-41 and MQ-41-L installation channels are used in building services engineering installation systems at ambient and elevated temperatures. Hilti MQ-41 D installation channel in the scope of this European Technical Assessment is used only for applications at ambient temperatures.
- The resistance and deformation at ambient and elevated temperatures apply for static and centric actions. The resistance and deformation at elevated temperatures are referring to the boundary conditions of the standard temperature / time curve (STTC) in accordance with EN 1363-1.
- MQ-41/3, MQ-41/3 LL, MQ-21.5, MQ-41 and MQ-41-L channels used in headrail systems are installed with the channel profile open underneath. Tested fire-proof components are attached underneath using Hilti MQA-M10-B, MQA-M12-B or MQA-M16-B pipe ring saddles. The channels are mounted on the base material for use at elevated temperatures using MQZ-L11 or MQZ-L13 drilled plates in conjunction with suitable fasteners. MQ-41/3 and MQ-41/3 LL channels can be mounted on the base material for use at ambient temperatures with suitable fasteners through the longhole without using MQZ-L11 or MQZ-L13 drilled plates. MQ-21.5, MQ-41 and MQ-41-L channels can be mounted on the base material for use at ambient and elevated temperatures with suitable fasteners through the roundhole without using MQZ-L11 or MQZ-L13 drilled plates.
- In the case of suspended channel systems, the channel profiles are opened upwards or downwards. On the underside or on the top of suspended channel systems, tested fireproof components must be force-fitted and secured using Hilti MQZ-L11 or MQZ-L13 drilled plates, nuts and threaded rods. Hilti MQA-M10-B, MQA-M12-B or MQA-M16-B pipe ring saddles can also be used as an alternative. Implementing the nodes between the channel and the threaded rod used for the suspension must take place using force-fitted Hilti MQZ-L11 or MQZ-L13 drilled plates and nuts as well as threaded rods.
- The installation channels are cut to length centrally between the longholes or the roundholes at the marking. The cut channel lies within a range of 2 mm from both sides of the marking.
- Threaded rods and other fixtures are only to be guided through the closed roundholes or longholes in the back of the channel.
- The anchoring used with the base material must be suitable and have a fireproof certificate.
- Prior to installation, it must be ensured that the components to be supported by the installation channels, the connection components, the anchoring of the channels to the base material and the base material itself are suitable to withstand the resistance values of the channels as well as installation systems and that they have a fireproof certificate.
- The installation channels must be installed by appropriately qualified personnel and under the supervision of the site manager. The general installation instructions of the manufacturer apply.

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L	Annex B1
Requirements for performance assessment	

- The pull-through resistance from the holes in the back of the channels at ambient and elevated temperatures results in connection with the fasteners as per Table B2.

Table B2: Fasteners for channel fixation through back holes

No.	Material and geometry of fastener	Illustration [Dimensions in mm]	Installation channel
1	Steel galvanized, $f_{uk} \geq 810 \text{ N/mm}^2$ Hexagon head, WAF 13 mm		MQ-21.5 (round hole) MQ-41 (round hole) MQ-41-L (round hole)
2	Steel galvanized, $f_{uk} \geq 805 \text{ N/mm}^2$ Hexagon head, WAF 15 mm		MQ-41/3 MQ-41/3 LL
3	Bolt: M12, strength class 4.8 in accordance with DIN 976-1, zinc coated Washer: EN ISO 7089 – 13 – 200 HV, zinc coated Hexagon nut: M12, strength class 8 in accordance with ISO 4032, zinc coated	-	MQ-41/3 MQ-41/3 LL
4	Bolt: M10, strength class 4.8 in accordance with DIN 976-1, zinc coated Washer: EN ISO 7089 – 10.5 – 200 HV, zinc coated Hexagon nut: M10, strength class 8 in accordance with ISO 4032, zinc coated	-	MQ-21.5 (round hole) MQ-41 (round hole) MQ-41-L (round hole)

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L

Requirements for performance assessment

Annex B2

Table B3: Section properties of installation channels

Description	Symbol	MQ-41/3	MQ-41/3 LL	MQ-41 D	MQ-21.5	MQ-41	MQ-41-L	Unit
Classification cross section in accordance with EN 1993-1-1	-	3	3	3	3	3	3	-
Cross section areas	A	375.88	379.93	545.97	142.71	263.62	199.57	mm ²
	A _{tot}	375.88	379.93	545.97	142.71	263.62	199.57	mm ²
Shear areas	A _y	48.69	54.43	66.37	23.47	27.23	20.24	mm ²
	A _z	195.47	194.59	197.58	41.86	131.51	98.37	mm ²
Centroid position	Y _{C,0}	19.15	19.15	0.00	0.00	19.65	0.00	mm
	Z _{C,0}	20.57	20.76	0.00	-9.12	20.52	-19.91	mm
Moments of inertia	I _y	76963.50	78224.80	323585.00	9168.75	57501.00	44773.00	mm ⁴
	I _z	107949.00	108011.00	154070.00	37416.40	76416.00	58981.50	mm ⁴
Inclination of principal axes	α	90.00	90.00	0.00	90.00	90.00	90.00	°
Polar moments of inertia	I _p	184913.00	186236.00	477656.00	46585.10	133917.00	103754.00	mm ⁴
	I _{p,M}	778900.00	780561.00	477656.00	115093.00	601859.00	469974.00	mm ⁴
Radii of gyration	i _y	14.31	14.35	24.35	8.02	14.77	14.98	mm
	i _z	16.95	16.86	16.80	16.19	17.03	17.19	mm
Polar radii of gyration	i _p	22.18	22.14	29.58	18.07	22.54	22.80	mm
	i _{p,M}	45.52	45.33	29.58	28.40	47.78	48.53	mm
Warping radius of gyration	i _{w,M}	7.02	7.02	17.32	6.85	7.19	7.44	mm
Torsional constant	J	848.88	856.29	575.03	76.58	269.75	112.13	mm ⁴
Secondary torsional constant	J _s	105319.00	105394.00	91246.30	25157.50	74075.40	565590.00	mm ⁴
Location of the shear center	Y _{M,0}	19.15	19.15	0.00	0.00	19.65	0.00	mm
	Z _{M,0}	60.32	60.31	0.00	12.77	62.63	22.92	mm
	Y _M	0.00	0.00	0.00	0.00	0.00	0.00	mm
	Z _M	39.75	39.55	0.00	21.90	42.11	42.84	mm
Warping constants	I _{w,C}	2.09277E+08	2.07678E+08	1.43225E+08	23255400.00	1.66135E+08	1.34296E+08	mm ⁶
	I _{w,M}	38387600	38417600.00	1.43225E+08	5395050.00	31116700.00	26017600	mm ⁶
	r _{w,M}	0.00	0.00	0.00	0.00	0.00	0.00	-
Section moduli	S _{y,max}	4002.48	4108.45	7834.29	928.54	2906.72	2248.07	mm ³
	S _{y,min}	-3487.10	-3514.15	-7833.74	-788.66	-2672.22	-2093.62	mm ³
	S _{z,max}	5227.58	5230.56	7460.71	1811.93	3700.53	2856.29	mm ³
	S _{z,min}	-5277.58	-5230.56	-7460.71	-1811.93	-3700.54	-2856.25	mm ³
Torsional section modulus	S _t	282.96	285.43	287.51	51.06	134.88	75.76	mm ³
Max. plastic bending moment	M _{pl,y,k}	NPA ³⁾	NPA	NPA	NPA	NPA	NPA	kNm
	M _{pl,z,k}	NPA	NPA	NPA	NPA	NPA	NPA	kNm
Max. plastic section moduli	Z _y	NPA	NPA	NPA	NPA	NPA	NPA	mm ³
	Z _z	NPA	NPA	NPA	NPA	NPA	NPA	mm ³
Plastic shear areas	A _{pl,y}	NPA	NPA	NPA	NPA	NPA	NPA	mm ²
	A _{pl,z}	NPA	NPA	NPA	NPA	NPA	NPA	mm ²
Area bisecting axis position	f _{v,0}	NPA	NPA	NPA	NPA	NPA	NPA	mm
	f _{z,0}	NPA	NPA	NPA	NPA	NPA	NPA	mm
Plastic shear forces	V _{pl,y,k}	NPA	NPA	NPA	NPA	NPA	NPA	kN
	V _{pl,z,k}	NPA	NPA	NPA	NPA	NPA	NPA	kN
Plastic axial force	N _{pl,k}	NPA	NPA	NPA	NPA	NPA	NPA	kN
Buckling curves	BC _y	c	c	c	c	c	c	-
	BC _z	c	c	c	c	c	c	-

3) NPA: No performance assessed

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L

Requirements for performance assessment

Annex B3

Table C1: Characteristic pull-through resistance from the holes in the back of the channels at ambient temperatures

Installation channel	Characteristic pull-through resistance ⁴⁾
	F_{Rk} [kN]
MQ-41/3	13.01
MQ-41/3 LL	
MQ-41 D	NPA ⁶⁾
MQ-21.5	11.95
MQ-41	17.54
MQ-41-L	8.59

⁴⁾ For MQ-41/3 and MQ-41/3 LL, the performance applies regardless of the position of the fastener in the longholes in the back of the channels;
For MQ-21.5, MQ-41 und MQ-41-L, the performance applies with the position of the fastener in the roundholes in the back of the channels.

⁵⁾ provided that no other national regulations apply

⁶⁾ NPA: No performance assessed

Notes:

- The characteristic resistances do not consider deflections.
- Partial safety factor for design resistance is $\gamma_M = F_{Rk} / F_{Rd}$.
- For design resistances the manufacturer's specifications and national regulations must be observed.

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L

Characteristic pull-through resistance of channel back holes at ambient temperature

Annex C

Table D1: Pull-through resistance $F_{Rk,t}$ from the roundholes in the back of the channels at elevated temperatures after 30, 60 and 90 minutes

Installation channel	Pull-through resistance		
	$F_{Rk,t}$ [kN]		
	t = 30 minutes	t = 60 minutes	t = 90 minutes
MQ-41	1.92	1.01	0.71
MQ-41-L	1.29	NPA ⁷⁾	NPA
MQ-21.5	1.75	NPA	NPA

⁷⁾NPA: No performance assessed

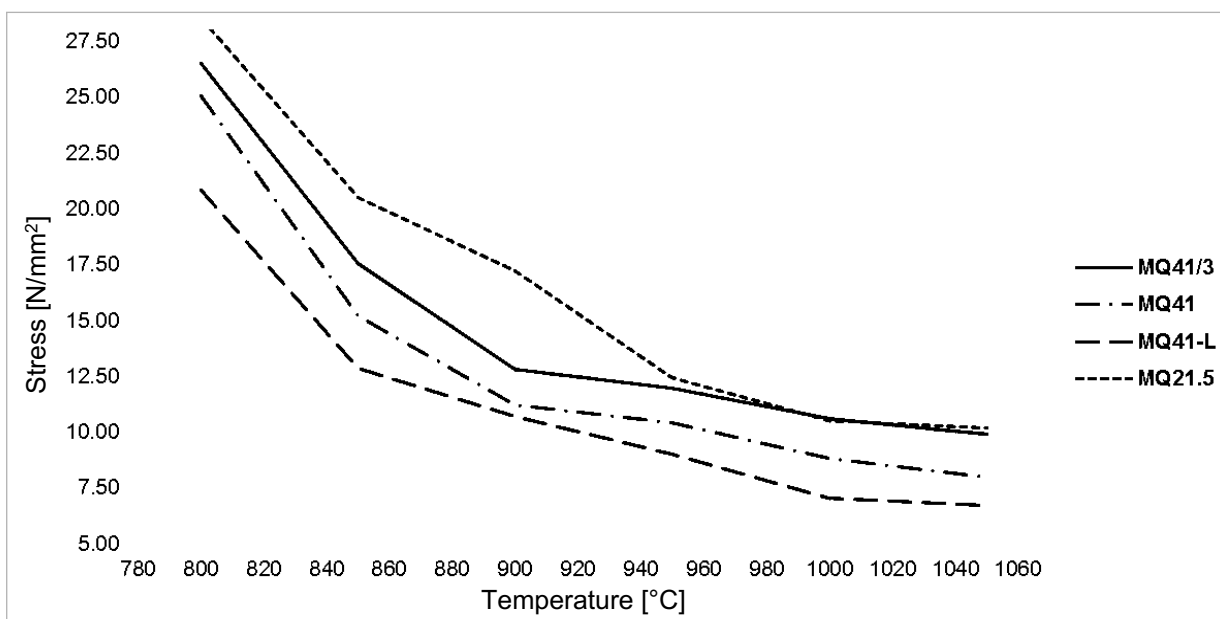
Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L

Pull-through resistance of channel back holes at elevated temperatures

Annex D1

Table D2.1: Channel material stress⁸⁾ at different temperatures of the component and $\varepsilon_{B,0a} = 2\%$

Temperature [°C]	Stress [N/mm ²]			
	MQ-41/3 or MQ-41/3 LL	MQ-41	MQ-41-L	MQ-21.5
800	26.51	25.06	20.83	28.53
842*	19.00	16.77	14.11	21.80
850	17.57	15.19	12.83	20.52
900	12.82	11.21	10.69	17.24
945*	12.05	10.49	9.19	12.91
950	11.96	10.41	9.02	12.43
1000	10.58	8.82	7.02	10.52
1006*	10.50	8.72	6.98	10.48
1049*	9.91	7.97	6.73	10.18
1050	9.90	7.96	6.73	10.17



⁸⁾ determined based on unsteady thermal creep tests

⁹⁾ interpolated values of the channel material stress

Table D2.2: Temperatures ⁹⁾ after 30, 60, 90 and 120 minutes according to standard temperature / time curve (STTC)

Time according to STTC [min]	30	60	90	120
Temperature [°C]	842	945	1006	1049

⁹⁾ Furnace temperatures according to STTC;









It can be assumed that the component temperature corresponds to the furnace temperature.

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L

Stress-strain behaviour at elevated temperatures

Annex D2

Table D3: Calculation-based deformation at elevated temperatures for installation channels MQ-41/3 and MQ-41/3 LL

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(1)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.50	228.38	35.53	120.00	1.38	13.86	21.48	35.53
		10	0.50	461.05	38.74	120.00	2.26	15.52	24.24	38.74
		15	0.50	693.72	44.14	120.00	3.45	18.00	28.31	44.14
		20	0.50	926.38	59.74	120.00	4.98	23.86	38.03	59.74
		25	0.50	1159.05	72.32	107.09	7.14	32.54	55.25	152.22
		30	0.50	1391.72	60.10	73.76	10.48	45.71	152.09	152.22
		5	0.50	228.38	35.47	120.00	1.37	13.83	21.43	35.47
		10	0.50	461.05	37.88	120.00	2.02	15.09	23.50	37.88
		15	0.50	693.72	42.03	120.00	3.00	17.03	26.64	42.03
		20	0.50	926.38	51.00	120.00	4.18	20.82	32.85	51.00
		25	0.50	1159.05	37.29	80.01	5.79	26.79	70.44	102.25
		30	0.50	1391.72	26.13	46.68	8.17	61.69	-	-
		5	0.67	171.29	35.90	120.00	1.43	14.06	21.85	35.90
		10	0.67	345.79	40.56	120.00	2.73	16.34	25.63	40.56
		15	0.67	520.29	52.67	120.00	4.32	21.31	33.87	52.67
		20	0.67	694.79	75.00	120.00	6.69	31.03	49.89	75.00
		25	0.67	869.29	84.98	107.92	10.66	43.74	68.22	152.22
		30	0.67	1043.79	72.10	74.59	18.43	58.97	152.09	152.22
		5	0.67	171.29	35.75	120.00	1.42	13.99	21.70	35.75
		10	0.67	345.79	39.43	120.00	2.48	15.84	24.74	39.43
		15	0.67	520.29	46.04	120.00	3.75	18.89	29.65	46.04
		20	0.67	694.79	61.98	120.00	5.49	25.54	40.35	61.98
		25	0.67	869.29	64.98	100.42	7.99	34.69	54.92	-
		30	0.67	1043.79	53.97	68.34	12.00	46.05	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation

ε_{B,θ_a}	Channel bending strain at elevated temperatures θ_a
σ_B	Channel bending stress
V	Momentum degree of fullness
F	Load
$\delta_{t_{max};B}$	Deformation of the channel at the point in time of stability failure or of the plastic hinging
$t_{max,B}$	Time in which loss of rigidity or plastic hinging of the channel occurs under bending stress
δ_{30}	Displacement after exposure time of 30 minutes to elevated temperatures
δ_{60}	Displacement after exposure time of 60 minutes to elevated temperatures
δ_{90}	Displacement after exposure time of 90 minutes to elevated temperatures
δ_{120}	Displacement after exposure time of 120 minutes to elevated temperatures

Thermal analyses as well as calculations are referring to the boundary conditions of STTC

Hilti installation channel MQ-41/3 and MQ-41/3 LL	Annex D3
Bending characteristics of the channel at elevated temperatures	

English translation prepared by DIBt

Table D4: Calculation-based deformation at elevated temperatures for installation channels MQ-41/3 and MQ-41/3 LL

System [Dimensions in mm]	Load direction	σ_B [N/mm ²]	$V^{(10)}$ -	$F^{(11)}$ [N]	$\delta_{t_{max};B}$ [mm]	$t_{max,B}$ [min]	δ_{30} [mm]	δ_{60} [mm]	δ_{90} [mm]	δ_{120} [mm]
		5	0.5	132.46	36.39	120.00	1.59	14.33	22.24	36.39
		10	0.5	272.06	44.98	120.00	3.95	18.71	29.54	44.98
		15	0.5	411.66	62.13	120.00	7.10	26.15	41.96	62.13
		20	0.5	551.26	104.64	120.00	11.31	42.64	69.55	104.64
		25	0.5	690.86	117.01	98.34	17.56	66.29	105.99	199.40
		30	0.5	830.46	106.27	68.76	28.04	94.16	248.76	253.70
		5	0.5	132.46	36.06	120.00	1.54	14.16	21.93	36.06
		10	0.5	272.06	41.96	120.00	3.18	17.24	27.02	41.96
		15	0.5	411.66	51.24	120.00	5.52	21.66	34.21	51.24
		20	0.5	551.26	72.77	120.00	8.29	31.01	49.06	72.77
		25	0.5	690.86	102.25	120.00	12.06	44.70	70.44	102.25
		30	0.5	830.46	86.77	81.26	17.55	61.69	-	-
		5	0.80	165.58	38.33	120.00	1.94	15.38	24.11	38.33
		10	0.80	340.08	54.75	120.00	6.39	23.04	36.94	54.75
		15	0.80	514.58	105.04	84.17	11.77	47.40	148.06	184.14
		20	0.80	689.08	93.67	49.18	21.26	194.92	235.68	253.70
		25	0.80	863.58	35.68	27.93	163.26	225.24	253.48	253.70
		30	0.80	1038.08	27.05	23.35	187.95	243.73	253.48	253.70
		5	0.80	165.58	36.97	120.00	1.72	14.65	22.78	36.97
		10	0.80	340.08	47.37	120.00	4.71	19.92	31.41	47.37
		15	0.80	514.58	64.51	120.00	8.21	28.07	44.34	64.51
		20	0.80	689.08	90.89	113.75	12.98	45.55	68.48	-
		25	0.80	863.58	74.29	69.17	20.08	64.16	-	-
		30	0.80	1038.08	64.08	42.09	31.28	-	-	-
		5	0.67	55.19	37.41	120.00	1.78	14.88	23.23	37.41
		10	0.67	113.36	50.00	120.00	5.32	21.09	33.48	50.00
		15	0.67	171.53	78.05	120.00	9.55	34.01	53.83	78.05
		20	0.67	229.69	113.97	120.00	15.78	56.14	83.44	113.97
		25	0.67	287.86	140.77	120.00	25.97	77.66	108.87	140.77
		30	0.67	346.03	162.19	117.50	42.50	96.39	129.74	207.98
		5	0.67	55.19	36.61	120.00	1.65	14.45	22.45	36.61
		10	0.67	113.36	45.17	120.00	4.11	18.85	29.65	45.17
		15	0.67	171.53	59.59	120.00	7.16	25.58	40.49	59.59
		20	0.67	229.69	89.54	120.00	11.11	39.97	62.32	89.54
		25	0.67	287.86	83.60	85.00	16.79	58.32	-	-
		30	0.67	346.03	75.29	56.26	25.67	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41/3 and MQ-41/3 LL

Bending characteristics of the channel at elevated temperatures

Annex D4

English translation prepared by DIBt

Table D5: Calculation-based deformation at elevated temperatures for installation channels MQ-41/3 and MQ-41/3 LL

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max},B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	89.72	37.80	120.00	1.95	15.09	23.49	37.80
		10	0.5	189.44	54.69	120.00	6.59	23.71	37.82	54.69
		15	0.5	289.15	88.10	120.00	12.77	38.85	62.36	88.10
		20	0.5	388.87	152.11	120.00	21.01	68.99	107.88	152.11
		25	0.5	488.58	199.40	120.00	33.45	105.09	155.72	199.40
		30	0.5	588.29	183.72	85.00	53.13	141.14	248.76	355.17
		5	0.5	89.72	36.93	120.00	1.81	14.63	22.66	36.93
		10	0.5	189.44	47.65	120.00	4.80	20.26	31.93	47.65
		15	0.5	289.15	64.63	120.00	9.03	28.38	45.13	64.63
		20	0.5	388.87	101.06	120.00	14.08	45.02	70.98	101.06
		25	0.5	488.58	126.68	105.42	20.88	68.18	104.23	-
		30	0.5	588.29	113.11	71.26	30.90	94.77	-	-
		5	0.86	157.01	41.88	120.00	2.66	17.27	27.42	41.88
		10	0.86	331.51	107.73	120.00	11.89	33.30	56.92	107.73
		15	0.86	506.01	184.14	120.00	23.34	104.82	148.06	184.14
		20	0.86	680.51	51.98	29.18	127.10	194.92	235.68	270.33
		25	0.86	855.01	36.27	24.18	163.26	225.24	259.10	295.75
		30	0.86	1029.51	33.65	22.10	187.95	243.73	280.16	311.98
		5	0.86	157.01	38.58	120.00	2.15	15.51	24.19	38.58
		10	0.86	331.51	58.11	120.00	7.54	25.49	40.47	58.11
		15	0.86	506.01	87.14	120.00	14.35	40.19	63.12	87.14
		20	0.86	680.51	96.76	86.25	23.43	67.99	-	-
		25	0.86	855.01	82.43	46.26	36.63	-	-	-
		30	0.86	1029.51	75.31	34.60	54.77	-	-	-
		5	0.67	26.17	39.84	120.00	2.32	16.20	25.46	39.84
		10	0.67	55.25	64.06	120.00	9.24	28.26	45.22	64.06
		15	0.67	84.34	107.50	120.00	17.42	51.92	79.27	107.50
		20	0.67	113.42	152.23	120.00	29.17	85.21	118.31	152.23
		25	0.67	142.50	183.14	120.00	46.78	112.45	147.95	183.14
		30	0.67	171.59	207.98	120.00	69.55	134.11	171.86	207.98
		5	0.67	26.17	37.87	120.00	1.99	15.14	23.53	37.87
		10	0.67	55.25	53.20	120.00	6.39	23.07	36.52	53.20
		15	0.67	84.34	77.89	120.00	11.90	34.90	55.32	77.89
		20	0.67	113.42	121.08	120.00	18.96	58.94	89.09	121.08
		25	0.67	142.50	107.19	75.01	29.18	86.80	-	-
		30	0.67	171.59	95.91	44.59	44.40	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load













Symbols and designation see Annex D3

Hilti installation channel MQ-41/3 and MQ-41/3 LL

Bending characteristics of the channel at elevated temperatures

Annex D5

Table D6: Calculation-based deformation at elevated temperatures for installation channels MQ-41/3 and MQ-41/3 LL

System [Dimensions in mm]	Load direction	σ_B	$V^{10)}$	$F^{11)}$	$\delta_{t_{max,B}}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	64.71	39.79	120.00	2.45	16.18	25.27	39.79
		10	0.5	142.26	67.91	120.00	10.22	30.54	49.10	67.91
		15	0.5	219.82	118.55	120.00	20.45	55.34	87.37	118.55
		20	0.5	297.38	202.14	120.00	33.90	99.74	149.83	202.14
		25	0.5	374.93	256.64	120.00	53.47	146.62	207.67	256.64
		30	0.5	452.49	292.63	119.17	82.09	191.04	248.76	359.01
		5	0.5	64.71	38.05	120.00	2.16	15.25	23.61	38.05
		10	0.5	142.26	54.62	120.00	6.81	23.98	37.96	54.62
		15	0.5	219.82	81.28	120.00	13.36	36.82	58.71	81.28
		20	0.5	297.38	132.14	120.00	21.28	61.67	96.20	132.14
		25	0.5	374.93	153.03	95.84	31.96	95.35	140.86	-
		30	0.5	452.49	142.98	65.01	47.38	131.00	-	-
		5	0.89	145.60	46.41	120.00	3.55	19.65	31.63	46.41
		10	0.89	320.10	149.86	120.00	19.22	48.31	110.45	149.86
		15	0.89	494.60	211.68	120.00	40.54	136.35	176.46	211.68
		20	0.89	669.10	61.78	27.10	127.10	194.92	235.68	270.33
		25	0.89	843.60	85.46	22.93	163.26	225.24	259.10	295.75
		30	0.89	1018.10	36.98	20.85	187.95	243.73	280.16	311.98
		5	0.89	145.60	40.02	120.00	2.55	16.27	25.41	40.02
		10	0.89	320.10	69.45	120.00	10.47	31.58	50.23	69.45
		15	0.89	494.60	107.88	120.00	21.20	52.17	81.08	107.88
		20	0.89	669.10	105.36	74.17	34.71	87.33	-	-
		25	0.89	843.60	90.19	40.01	53.46	-	-	-
		30	0.89	1018.10	81.33	30.85	75.45	-	-	-
		5	0.67	14.56	43.33	120.00	3.11	18.12	28.66	43.33
		10	0.67	32.01	82.40	120.00	14.59	37.91	60.70	82.40
		15	0.67	49.46	138.22	120.00	27.91	73.38	107.23	138.22
		20	0.67	66.91	189.41	120.00	46.31	115.49	153.39	189.41
		25	0.67	84.36	224.43	120.00	71.01	146.93	186.41	224.43
		30	0.67	101.81	251.27	120.00	97.80	171.55	212.61	251.27
		5	0.67	14.56	39.48	120.00	2.43	16.00	24.92	39.48
		10	0.67	32.01	63.24	120.00	9.14	28.36	45.10	63.24
		15	0.67	49.46	99.34	120.00	17.84	46.34	73.19	99.34
		20	0.67	66.91	154.86	118.33	28.82	80.55	117.81	-
		25	0.67	84.36	134.87	70.01	44.29	116.77	-	-
		30	0.67	101.81	122.14	42.09	66.19	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load













Symbols and designation see Annex D3

Hilti installation channel MQ-41/3 and MQ-41/3 LL

Bending characteristics of the channel at elevated temperatures

Annex D6

Table D7: Calculation-based deformation at elevated temperatures for installation channels MQ-41/3 and MQ-41/3 LL

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	47.75	42.50	120.00	3.11	17.65	27.69	42.50
		10	0.5	111.21	84.54	120.00	14.91	39.28	63.33	84.54
		15	0.5	174.66	152.99	120.00	30.10	75.44	116.60	152.99
		20	0.5	238.12	253.18	120.00	49.85	133.85	194.08	253.18
		25	0.5	301.57	316.03	120.00	77.29	190.76	261.37	316.03
		30	0.5	365.03	359.01	120.00	114.60	243.07	309.53	359.01
		5	0.5	47.75	39.43	120.00	2.60	16.00	24.75	39.43
		10	0.5	111.21	62.88	120.00	9.18	28.41	45.17	62.88
		15	0.5	174.66	100.75	120.00	18.49	46.87	74.69	100.75
		20	0.5	238.12	164.99	120.00	29.80	80.61	123.97	164.99
		25	0.5	301.57	173.86	84.59	45.13	125.07	-	-
		30	0.5	365.03	166.08	55.43	66.60	-	-	-
		5	0.91	131.32	51.73	120.00	4.58	22.39	36.55	51.73
		10	0.91	305.82	172.29	120.00	28.45	75.38	136.81	172.29
		15	0.91	480.32	238.74	120.00	69.86	159.36	202.29	238.74
		20	0.91	654.82	270.33	120.00	127.10	194.92	235.68	270.33
		25	0.91	829.32	295.75	120.00	163.26	225.24	259.10	295.75
		30	0.91	1003.82	311.98	120.00	187.95	243.73	280.16	311.98
		5	0.91	131.32	41.80	120.00	3.08	17.22	26.90	41.80
		10	0.91	305.82	82.66	120.00	13.81	38.72	61.53	82.66
		15	0.91	480.32	133.06	120.00	29.49	67.01	102.73	133.06
		20	0.91	654.82	120.45	66.67	48.43	108.91	-	-
		25	0.91	829.32	105.72	36.68	73.31	-	-	-
		30	0.91	1003.82	96.53	29.60	-	-	-	-
		5	0.67	8.75	48.11	120.00	4.21	20.75	33.09	48.11
		10	0.67	20.39	104.47	120.00	21.42	50.06	79.62	104.47
		15	0.67	32.02	169.62	120.00	40.92	97.01	136.36	169.62
		20	0.67	43.65	225.92	120.00	66.46	145.97	188.02	225.92
		25	0.67	55.29	265.07	120.00	97.11	181.01	224.76	265.07
		30	0.67	66.92	294.94	120.00	126.94	208.33	253.36	294.94
		5	0.67	8.75	41.46	120.00	2.98	17.07	26.64	41.46
		10	0.67	20.39	75.04	120.00	12.35	34.66	55.26	75.04
		15	0.67	32.02	123.62	120.00	24.83	59.74	93.74	123.62
		20	0.67	43.65	170.13	105.00	40.54	103.90	147.69	-
		25	0.67	55.29	154.72	62.09	62.06	149.82	-	-
		30	0.67	66.92	141.72	38.76	90.20	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-41 D, MQ-21.5, MQ-41 and MQ-41-L

Bending characteristics of the channel at elevated temperatures

Annex D7

Table D8: Calculation-based deformation at elevated temperatures for installation channels MQ-41/3 and MQ-41/3 LL

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max},B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	35.14	46.07	120.00	3.95	19.58	30.91	46.07
		10	0.5	88.83	104.75	120.00	20.73	50.08	80.71	104.75
		15	0.5	142.52	190.06	120.00	41.80	98.83	149.08	190.06
		20	0.5	196.21	303.18	120.00	68.74	170.20	238.68	303.18
		25	0.5	249.91	375.68	120.00	104.42	235.35	314.72	375.68
		30	0.5	303.60	425.50	120.00	149.25	294.87	370.85	425.50
		5	0.5	35.14	41.13	120.00	3.14	16.93	26.18	41.13
		10	0.5	88.83	72.85	120.00	11.94	33.78	53.87	72.85
		15	0.5	142.52	123.63	120.00	24.52	58.78	93.54	123.63
		20	0.5	196.21	201.19	120.00	39.94	102.56	155.13	201.19
		25	0.5	249.91	182.28	71.26	60.79	158.01	-	-
		30	0.5	303.60	155.87	40.01	89.37	-	-	-
		5	0.92	114.19	57.49	120.00	5.70	25.32	41.84	57.49
		10	0.92	288.69	195.07	120.00	39.80	103.44	158.37	195.07
		15	0.92	463.19	264.07	120.00	96.84	177.89	225.18	264.07
		20	0.92	637.69	309.47	120.00	149.84	223.77	270.02	309.47
		25	0.92	812.19	334.61	120.00	186.59	254.48	298.33	334.61
		30	0.92	986.69	349.63	120.00	213.06	274.66	315.34	349.63
		5	0.92	114.19	43.73	120.00	3.69	18.26	28.51	43.73
		10	0.92	288.69	97.08	120.00	17.48	46.60	73.98	97.08
		15	0.92	463.19	152.03	112.50	38.90	83.71	126.18	-
		20	0.92	637.69	113.56	45.01	64.10	-	-	-
		25	0.92	812.19	95.46	30.01	95.34	-	-	-
		30	0.92	986.69	92.10	26.26	-	-	-	-
		5	0.67	5.44	54.46	120.00	5.70	24.28	38.98	54.46
		10	0.67	13.75	129.56	120.00	29.82	64.68	101.48	129.56
		15	0.67	22.06	201.47	120.00	56.33	121.83	166.04	201.47
		20	0.67	30.37	261.82	120.00	88.88	176.19	222.06	261.82
		25	0.67	38.68	304.81	120.00	124.15	214.59	262.42	304.81
		30	0.67	46.99	337.85	120.00	156.62	244.37	293.72	337.85
		5	0.67	5.44	43.91	120.00	3.64	18.39	28.76	43.91
		10	0.67	13.75	89.18	120.00	16.08	42.21	67.35	89.18
		15	0.67	22.06	150.92	120.00	33.01	75.28	117.01	150.92
		20	0.67	30.37	174.17	85.42	54.33	129.32	-	-
		25	0.67	38.68	145.31	42.09	82.78	-	-	-
		30	0.67	46.99	126.36	30.85	116.76	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load









Symbols and designation see Annex D3

Hilti installation channel MQ-41/3 and MQ-41/3 LL

Bending characteristics of the channel at elevated temperatures

Annex D8

Table D9: Calculation-based deformation at elevated temperatures for installation channel MQ-41

System [Dimensions in mm]	Load direction	σ_B	$V^{10)}$	$F^{11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	175.10	5.70	120.00	5.70	5.70	5.70	5.70
		10	0.5	353.25	7.23	120.00	6.76	6.76	6.76	7.23
		15	0.5	531.40	17.95	93.33	8.09	9.99	16.44	58.20
		20	0.5	709.55	18.34	43.33	10.27	68.30	135.70	152.22
		25	0.5	887.70	19.05	31.67	14.27	151.91	152.09	152.22
		30	0.5	1065.84	18.91	28.34	143.70	151.91	-	-
		5	0.5	175.10	5.76	120.00	5.76	5.76	5.76	5.76
		10	0.5	353.25	8.26	120.00	6.91	6.91	7.28	8.26
		15	0.5	531.40	17.06	96.67	8.53	11.33	16.31	50.72
		20	0.5	709.55	17.49	40.00	11.36	52.81	152.09	152.22
		25	0.5	887.70	13.87	28.34	33.66	151.91	152.09	-
		30	0.5	1065.84	10.66	23.34	151.60	-	-	-
		5	0.67	131.33	5.94	120.00	5.94	5.94	5.94	5.94
		10	0.67	264.94	10.70	120.00	7.39	7.39	9.47	10.70
		15	0.67	398.55	24.36	120.00	9.45	14.49	20.63	24.36
		20	0.67	532.16	40.28	120.00	13.21	25.13	34.16	40.28
		25	0.67	665.77	42.94	78.33	20.20	36.53	-	-
		30	0.67	799.38	44.37	46.67	31.03	-	-	-
		5	0.67	131.33	6.03	120.00	6.03	6.03	6.03	6.03
		10	0.67	264.94	12.15	120.00	7.61	7.67	10.65	12.15
		15	0.67	398.55	39.57	120.00	10.06	17.35	26.67	39.57
		20	0.67	532.16	43.99	61.67	14.86	41.59	80.71	92.13
		25	0.67	665.77	35.10	31.67	26.62	81.08	-	-
		30	0.67	799.38	20.58	25.00	69.53	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load













Symbols and designation see Annex D3

Hilti installation channel MQ-41

Bending characteristics of the channel at elevated temperatures

Annex D9

Table D10: Calculation-based deformation at elevated temperatures for installation channel MQ-41

System [Dimensions in mm]	Load direction	σ_B	$V^{10)}$	$F^{11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	101.81	6.76	120.00	6.76	6.76	6.76	6.76
		10	0.5	208.70	20.45	120.00	9.67	13.50	18.21	20.45
		15	0.5	315.59	58.21	120.00	13.47	29.05	45.20	58.21
		20	0.5	422.48	85.13	88.33	20.06	68.34	135.71	213.28
		25	0.5	529.37	87.33	48.33	34.72	189.22	253.48	253.70
		30	0.5	636.26	35.07	26.67	143.66	253.18	-	-
		5	0.5	101.81	6.77	120.00	6.77	6.77	6.77	6.77
		10	0.5	208.70	20.72	120.00	9.72	13.79	18.52	20.72
		15	0.5	315.59	50.72	120.00	13.65	28.36	41.00	50.72
		20	0.5	422.48	53.95	61.67	20.52	52.81	198.93	253.70
		25	0.5	529.37	49.00	33.33	33.66	210.15	253.48	-
		30	0.5	636.26	48.33	28.34	157.90	-	-	-
		5	0.80	127.27	7.77	120.00	7.71	7.71	7.71	7.77
		10	0.80	260.88	31.70	120.00	12.15	20.71	27.92	31.70
		15	0.80	394.49	56.48	95.00	18.98	41.40	54.92	-
		20	0.80	528.10	58.44	45.00	32.96	-	-	-
		25	0.80	661.71	54.82	30.00	54.82	-	-	-
		30	0.80	795.32	19.57	21.67	-	-	-	-
		5	0.80	127.27	8.30	120.00	7.80	7.80	7.95	8.30
		10	0.80	260.88	34.66	120.00	12.39	22.27	30.63	34.66
		15	0.80	394.49	65.54	120.00	19.75	43.95	57.58	65.54
		20	0.80	528.10	92.13	120.00	33.23	64.35	80.71	92.13
		25	0.80	661.71	81.90	61.67	52.41	81.08	-	-
		30	0.80	795.32	78.01	33.33	69.53	-	-	-
		5	0.67	42.42	7.34	120.00	7.34	7.34	7.34	7.34
		10	0.67	86.96	28.41	120.00	11.14	18.21	25.05	28.41
		15	0.67	131.50	60.06	120.00	16.66	36.76	50.94	60.06
		20	0.67	176.03	93.99	120.00	26.88	58.98	78.24	93.99
		25	0.67	220.57	111.05	98.33	44.33	80.45	105.14	160.98
		30	0.67	265.11	109.68	70.00	66.66	100.60	199.35	222.25
		5	0.67	42.42	7.40	120.00	7.40	7.40	7.40	7.40
		10	0.67	86.96	29.50	120.00	11.32	19.00	26.11	29.50
		15	0.67	131.50	67.29	120.00	17.16	39.13	54.88	67.29
		20	0.67	176.03	89.02	83.33	28.17	65.55	126.64	178.15
		25	0.67	220.57	85.94	43.33	48.45	132.52	194.49	249.61
		30	0.67	265.11	71.34	28.34	111.71	190.73	253.48	253.70

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41

Bending characteristics of the channel at elevated temperatures

Annex D10

Table D11: Calculation-based deformation at elevated temperatures for installation channel MQ-41

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(1)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	69.25	8.35	120.00	8.35	8.35	8.35	8.35
		10	0.5	145.59	39.98	120.00	13.98	26.43	35.63	39.98
		15	0.5	221.94	102.55	120.00	21.48	53.98	80.75	102.55
		20	0.5	298.29	143.40	100.00	34.35	100.13	135.71	213.28
		25	0.5	374.64	132.95	53.33	61.57	189.22	292.59	355.17
		30	0.5	450.99	59.71	26.67	143.66	266.68	-	-
		5	0.5	69.25	8.38	120.00	8.38	8.38	8.38	8.38
		10	0.5	145.59	39.91	120.00	14.08	26.68	35.74	39.91
		15	0.5	221.94	96.36	120.00	21.69	53.02	74.88	96.36
		20	0.5	298.29	107.39	68.33	34.76	93.85	198.93	271.50
		25	0.5	374.64	94.81	35.00	59.43	210.15	315.51	-
		30	0.5	450.99	61.79	26.67	157.90	-	-	-
		5	0.86	121.18	15.41	120.00	10.30	13.05	14.75	15.41
		10	0.86	254.79	56.07	120.00	18.97	38.11	49.90	56.07
		15	0.86	388.40	69.64	66.67	32.51	66.21	-	-
		20	0.86	522.01	66.51	31.67	59.19	-	-	-
		25	0.86	655.62	23.60	21.67	-	-	-	-
		30	0.86	789.23	21.22	20.01	-	-	-	-
		5	0.86	121.18	16.28	120.00	10.39	13.75	15.65	16.28
		10	0.86	254.79	61.46	120.00	19.43	41.75	55.21	61.46
		15	0.86	388.40	94.11	120.00	33.40	69.74	85.75	94.11
		20	0.86	522.01	119.52	120.00	54.63	92.87	109.92	119.52
		25	0.86	655.62	114.89	68.33	77.02	109.79	-	-
		30	0.86	789.23	107.29	36.67	94.12	-	-	-
		5	0.67	20.20	12.36	120.00	9.50	10.50	11.84	12.36
		10	0.67	42.47	52.23	120.00	16.83	34.48	46.43	52.23
		15	0.67	64.73	92.70	120.00	27.35	62.43	81.48	92.70
		20	0.67	87.00	129.88	120.00	45.25	90.02	113.53	129.88
		25	0.67	109.27	160.98	120.00	70.01	113.99	140.47	160.98
		30	0.67	131.54	164.21	88.33	94.58	135.57	199.35	222.25
		5	0.67	20.20	12.61	120.00	9.55	10.75	12.10	12.61
		10	0.67	42.47	54.14	120.00	17.08	35.89	48.32	54.14
		15	0.67	64.73	100.02	120.00	28.10	66.50	87.00	100.02
		20	0.67	87.00	144.27	111.67	47.52	97.63	126.64	178.15
		25	0.67	109.27	141.23	68.33	75.76	132.52	194.49	249.61
		30	0.67	131.54	133.11	35.00	111.71	190.73	257.28	286.01

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41

Bending characteristics of the channel at elevated temperatures

Annex D11

Table D12: Calculation-based deformation at elevated temperatures for installation channel MQ-41

System [Dimensions in mm]	Load direction	σ_B	$V^{10)}$	$F^{11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	50.25	13.20	120.00	10.55	11.42	12.58	13.20
		10	0.5	109.63	64.29	120.00	19.83	43.24	57.56	64.29
		15	0.5	169.01	149.37	120.00	32.05	82.42	120.06	149.37
		20	0.5	228.40	213.28	120.00	52.32	143.39	187.38	213.28
		25	0.5	287.78	226.29	86.67	93.04	189.22	292.59	362.32
		30	0.5	347.16	193.92	43.33	143.66	266.68	-	-
		5	0.5	50.25	13.38	120.00	10.57	11.57	12.77	13.38
		10	0.5	109.63	63.70	120.00	19.89	43.33	57.32	63.70
		15	0.5	169.01	128.95	120.00	32.21	80.63	108.46	128.95
		20	0.5	228.40	162.26	76.67	52.56	126.72	198.93	271.50
		25	0.5	287.78	144.45	38.33	86.37	210.15	315.51	-
		30	0.5	347.16	88.93	26.67	157.90	-	-	-
		5	0.89	113.06	24.94	120.00	13.63	20.83	23.72	24.94
		10	0.89	246.67	76.78	120.00	27.38	56.87	70.06	76.78
		15	0.89	380.28	83.00	50.00	51.06	-	-	-
		20	0.89	513.89	71.39	28.34	-	-	-	-
		25	0.89	647.50	21.73	20.01	-	-	-	-
		30	0.89	781.12	16.95	18.34	-	-	-	-
		5	0.89	113.06	26.09	120.00	13.75	22.27	25.11	26.09
		10	0.89	246.67	89.31	120.00	28.57	63.78	81.25	89.31
		15	0.89	380.28	125.73	120.00	49.75	95.51	115.27	125.73
		20	0.89	513.89	151.51	120.00	77.23	121.28	140.78	151.51
		25	0.89	647.50	151.86	76.67	101.28	140.26	-	-
		30	0.89	781.12	142.60	41.67	120.16	-	-	-
		5	0.67	11.31	21.06	120.00	12.49	17.80	20.17	21.06
		10	0.67	24.67	79.51	120.00	24.48	54.43	71.34	79.51
		15	0.67	38.03	124.55	120.00	41.12	89.01	111.86	124.55
		20	0.67	51.39	163.69	120.00	66.37	120.43	146.80	163.69
		25	0.67	64.75	195.28	120.00	95.48	145.85	175.02	195.28
		30	0.67	78.11	222.25	120.00	121.12	168.00	199.35	222.25
		5	0.67	11.31	20.97	120.00	12.46	17.87	20.13	20.97
		10	0.67	24.67	82.30	120.00	24.72	56.54	74.16	82.30
		15	0.67	38.03	131.58	120.00	42.10	94.61	118.46	131.58
		20	0.67	51.39	178.15	120.00	69.37	129.47	157.98	178.15
		25	0.67	64.75	215.60	113.33	102.08	159.04	194.49	249.61
		30	0.67	78.11	211.13	75.00	131.96	190.73	257.28	286.01

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41

Bending characteristics of the channel at elevated temperatures

Annex D12

Table D13: Calculation-based deformation at elevated temperatures for installation channel MQ-41

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	37.42	20.43	120.00	13.44	17.70	19.51	20.43
		10	0.5	86.01	92.85	120.00	27.23	63.57	83.49	92.85
		15	0.5	134.59	200.96	120.00	45.10	114.41	163.86	200.96
		20	0.5	183.18	252.09	120.00	73.70	179.55	225.45	252.09
		25	0.5	231.77	294.87	91.67	130.32	243.51	292.59	362.32
		30	0.5	280.35	282.79	70.00	187.10	266.68	-	-
		5	0.5	37.42	20.31	120.00	13.39	17.61	19.41	20.31
		10	0.5	86.01	90.85	120.00	27.14	63.19	82.33	90.85
		15	0.5	134.59	157.21	120.00	44.95	109.47	140.60	157.21
		20	0.5	183.18	237.27	111.67	72.74	156.69	198.93	271.50
		25	0.5	231.77	234.67	70.00	111.64	210.15	315.51	-
		30	0.5	280.35	214.16	36.67	157.90	-	-	-
		5	0.91	102.91	36.43	120.00	17.59	30.10	34.42	36.43
		10	0.91	236.52	95.42	118.33	37.53	74.62	88.36	-
		15	0.91	370.13	97.08	43.33	69.20	-	-	-
		20	0.91	503.75	35.47	21.67	-	-	-	-
		25	0.91	637.36	32.65	20.01	-	-	-	-
		30	0.91	770.97	26.07	18.34	-	-	-	-
		5	0.91	102.91	37.29	120.00	17.81	32.10	35.90	37.29
		10	0.91	236.52	117.85	120.00	39.61	87.20	108.03	117.85
		15	0.91	370.13	159.74	120.00	67.98	122.83	147.09	159.74
		20	0.91	503.75	187.52	120.00	100.87	150.83	174.29	187.52
		25	0.91	637.36	191.04	83.33	126.77	172.16	-	-
		30	0.91	770.97	178.42	45.00	147.35	-	-	-
		5	0.67	6.86	32.65	120.00	16.43	27.43	31.25	32.65
		10	0.67	15.77	108.67	120.00	34.17	76.91	98.24	108.67
		15	0.67	24.68	157.86	120.00	57.62	116.27	143.11	157.86
		20	0.67	33.58	198.14	120.00	89.31	150.66	180.11	198.14
		25	0.67	42.49	231.53	120.00	121.17	178.48	210.58	231.53
		30	0.67	51.40	259.54	120.00	148.67	201.72	236.11	259.54
		5	0.67	6.86	31.80	120.00	16.21	27.05	30.54	31.80
		10	0.67	15.77	112.84	120.00	34.31	80.08	102.48	112.84
		15	0.67	24.68	166.29	120.00	58.90	123.92	151.68	166.29
		20	0.67	33.58	211.30	120.00	93.49	162.53	193.07	211.30
		25	0.67	42.49	249.61	120.00	129.49	193.67	227.32	249.61
		30	0.67	51.40	286.01	120.00	160.36	220.19	257.28	286.01

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41

Bending characteristics of the channel at elevated temperatures

Annex D13

Table D14: Calculation-based deformation at elevated temperatures for installation channel MQ-41

System [Dimensions in mm]	Load direction	σ_B	$V^{10)}$	$F^{11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	27.92	29.74	120.00	17.08	25.78	28.44	29.74
		10	0.5	69.03	124.98	120.00	36.24	87.10	112.80	124.98
		15	0.5	110.14	249.93	120.00	60.63	148.49	207.15	249.93
		20	0.5	151.25	295.69	120.00	98.02	217.63	264.92	295.69
		25	0.5	192.36	362.32	120.00	169.86	282.46	332.49	362.32
		30	0.5	233.47	344.97	88.33	223.15	315.90	-	-
		5	0.5	27.92	29.47	120.00	17.00	25.58	28.19	29.47
		10	0.5	69.03	122.42	120.00	36.15	86.68	111.39	122.42
		15	0.5	110.14	197.51	120.00	60.52	142.21	178.79	197.51
		20	0.5	151.25	271.50	120.00	96.70	195.73	240.34	271.50
		25	0.5	192.36	315.51	90.00	142.52	244.57	315.51	-
		30	0.5	233.47	300.95	53.33	189.40	-	-	-
		5	0.92	90.73	48.92	120.00	22.10	40.60	46.13	48.92
		10	0.92	224.34	111.70	113.33	49.76	91.37	105.57	-
		15	0.92	357.96	108.38	40.00	85.94	-	-	-
		20	0.92	491.57	27.10	20.01	-	-	-	-
		25	0.92	625.18	21.59	18.34	-	-	-	-
		30	0.92	758.79	20.81	16.67	-	-	-	-
		5	0.92	90.73	49.41	120.00	22.46	42.78	47.57	49.41
		10	0.92	224.34	147.09	120.00	52.23	111.42	135.43	147.09
		15	0.92	357.96	194.90	120.00	87.51	151.80	180.04	194.90
		20	0.92	491.57	225.98	120.00	125.19	181.72	210.20	225.98
		25	0.92	625.18	231.95	88.33	153.60	205.37	-	-
		30	0.92	758.79	213.08	46.67	175.76	-	-	-
		5	0.67	4.32	47.43	120.00	21.42	39.57	45.32	47.43
		10	0.67	10.68	138.64	120.00	45.85	100.90	126.06	138.64
		15	0.67	17.05	192.39	120.00	76.26	144.08	175.18	192.39
		20	0.67	23.41	233.69	120.00	113.26	180.67	213.76	233.69
		25	0.67	29.77	268.80	120.00	147.08	210.94	246.33	268.80
		30	0.67	36.13	298.60	120.00	176.42	236.24	273.93	298.60
		5	0.67	4.32	45.46	120.00	20.89	38.55	43.64	45.46
		10	0.67	10.68	145.14	120.00	45.91	105.80	132.55	145.14
		15	0.67	17.05	204.30	120.00	78.27	154.55	187.03	204.30
		20	0.67	23.41	250.89	120.00	119.47	196.79	231.06	250.89
		25	0.67	29.77	290.74	120.00	158.37	231.38	268.24	290.74
		30	0.67	36.13	324.72	120.00	191.82	260.32	299.60	324.72

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load









Symbols and designation see Annex D3

Hilti installation channel MQ-41

Bending characteristics of the channel at elevated temperatures

Annex D14

Table D15: Calculation-based deformation at elevated temperatures for installation channel MQ-41-L

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(1)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	137.27	9.99	120.00	9.99	9.99	9.99	9.99
		10	0.5	276.84	11.75	120.00	11.75	11.75	11.75	11.75
		15	0.5	416.42	15.86	63.33	14.16	15.28	63.03	121.65
		20	0.5	555.99	22.39	33.33	18.20	69.87	152.09	152.22
		25	0.5	695.57	18.42	26.67	61.00	151.91	-	-
		30	0.5	835.14	18.09	23.34	-	-	-	-
		5	0.5	137.27	10.15	120.00	10.15	10.15	10.15	10.15
		10	0.5	276.84	12.01	120.00	12.01	12.01	12.01	12.01
		15	0.5	416.42	13.83	55.00	14.77	35.75	152.09	-
		20	0.5	555.99	16.79	28.34	34.83	-	-	-
		25	0.5	695.57	10.20	21.67	55.63	-	-	-
		30	0.5	835.14	8.80	20.01	-	-	-	-
		5	0.67	102.95	10.34	120.00	10.34	10.34	10.34	10.34
		10	0.67	207.63	13.62	120.00	12.86	12.86	12.86	13.62
		15	0.67	312.31	29.55	120.00	16.42	17.49	26.28	29.55
		20	0.67	416.99	38.66	85.00	22.31	28.51	-	-
		25	0.67	521.68	38.73	58.33	30.58	-	-	-
		30	0.67	626.36	43.80	33.33	40.58	-	-	-
		5	0.67	102.95	10.53	120.00	10.53	10.53	10.53	10.53
		10	0.67	207.63	16.24	120.00	13.31	13.31	14.69	16.24
		15	0.67	312.31	31.42	73.33	17.59	22.19	66.63	74.91
		20	0.67	416.99	36.22	40.00	25.58	69.87	-	-
		25	0.67	521.68	29.51	26.67	67.64	-	-	-
		30	0.67	626.36	15.59	21.67	-	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41-L

Bending characteristics of the channel at elevated temperatures

Annex D15

Table D16: Calculation-based deformation at elevated temperatures for installation channel MQ-41-L

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max},B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	79.90	10.95	120.00	10.95	10.95	10.95	10.95
		10	0.5	163.65	26.35	120.00	15.87	15.95	24.25	26.35
		15	0.5	247.39	73.01	111.67	22.77	36.92	63.03	121.65
		20	0.5	331.14	71.90	61.67	35.02	69.87	201.48	220.73
		25	0.5	414.88	74.45	33.33	61.00	196.71	-	-
		30	0.5	498.63	18.72	21.67	-	-	-	-
		5	0.5	79.90	11.04	120.00	11.04	11.04	11.04	11.04
		10	0.5	163.65	26.71	120.00	16.04	16.40	24.60	26.71
		15	0.5	247.39	61.00	88.33	23.10	35.75	226.49	-
		20	0.5	331.14	62.72	53.33	34.83	-	-	-
		25	0.5	414.88	55.64	30.00	55.63	-	-	-
		30	0.5	498.63	52.94	25.00	-	-	-	-
		5	0.80	99.88	12.38	120.00	12.38	12.38	12.38	12.38
		10	0.80	204.56	43.96	93.33	20.52	27.36	42.80	-
		15	0.80	309.24	48.11	40.00	34.56	-	-	-
		20	0.80	413.92	39.52	25.00	-	-	-	-
		25	0.80	518.60	25.70	21.67	-	-	-	-
		30	0.80	623.28	17.19	20.01	-	-	-	-
		5	0.80	99.88	12.57	120.00	12.57	12.57	12.57	12.57
		10	0.80	204.56	43.79	120.00	20.93	27.66	40.11	43.79
		15	0.80	309.24	74.91	120.00	33.22	50.04	66.63	74.91
		20	0.80	413.92	71.07	61.67	50.28	69.87	-	-
		25	0.80	518.60	73.46	33.33	67.64	-	-	-
		30	0.80	623.28	32.67	21.67	-	-	-	-
		5	0.67	33.29	11.78	120.00	11.78	11.78	11.78	11.78
		10	0.67	68.19	35.63	120.00	18.46	21.99	32.61	35.63
		15	0.67	103.08	68.05	120.00	27.9	42.41	59.85	68.05
		20	0.67	137.97	97.11	108.33	42.42	63.00	86.84	132.76
		25	0.67	172.87	92.57	68.33	59.58	83.73	144.49	193.82
		30	0.67	207.76	92.59	43.33	77.67	135.12	199.59	221.04
		5	0.67	33.29	11.90	120.00	11.90	11.90	11.90	11.90
		10	0.67	68.19	37.75	120.00	18.89	23.36	34.73	37.75
		15	0.67	103.08	84.65	120.00	29.06	46.15	67.36	84.65
		20	0.67	137.97	85.76	71.67	45.24	73.06	177.08	242.63
		25	0.67	172.87	87.88	43.33	67.22	173.43	-	-
		30	0.67	207.76	26.73	21.67	-	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41-L

Bending characteristics of the channel at elevated temperatures

Annex D16

Table D17: Calculation-based deformation at elevated temperatures for installation channel MQ-41-L

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max},B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	54.44	12.36	120.00	12.36	12.36	12.36	12.36
		10	0.5	114.26	51.65	120.00	21.98	31.32	47.25	51.65
		15	0.5	174.07	121.65	120.00	35.56	67.76	104.96	121.65
		20	0.5	233.89	141.35	83.33	58.66	111.80	201.48	220.73
		25	0.5	293.71	133.40	50.00	99.30	196.71	-	-
		30	0.5	353.53	30.57	21.67	-	-	-	-
		5	0.5	54.44	12.48	120.00	12.48	12.48	12.48	12.48
		10	0.5	114.26	50.68	120.00	22.27	31.66	46.74	50.68
		15	0.5	174.07	101.13	86.67	35.87	64.12	226.49	-
		20	0.5	233.89	98.67	51.67	56.99	-	-	-
		25	0.5	293.71	93.66	30.00	93.64	-	-	-
		30	0.5	353.53	68.20	23.34	-	-	-	-
		5	0.86	95.27	17.01	120.00	15.30	15.30	16.35	17.01
		10	0.86	199.95	53.87	65.00	31.09	50.12	-	-
		15	0.86	304.63	52.31	28.34	-	-	-	-
		20	0.86	409.31	25.86	21.67	-	-	-	-
		25	0.86	513.99	19.34	20.01	-	-	-	-
		30	0.86	618.67	15.07	18.34	-	-	-	-
		5	0.86	95.27	16.90	120.00	15.55	15.55	16.35	16.90
		10	0.86	199.95	71.55	120.00	31.94	49.35	66.24	71.55
		15	0.86	304.63	102.82	120.00	52.49	75.56	94.61	102.82
		20	0.86	409.31	99.17	63.33	74.46	96.68	-	-
		25	0.86	513.99	99.97	35.00	92.12	-	-	-
		30	0.86	618.67	53.21	21.67	-	-	-	-
		5	0.67	15.88	14.08	120.00	14.08	14.08	14.08	14.08
		10	0.67	33.32	61.97	120.00	26.90	40.45	57.00	61.97
		15	0.67	50.77	99.67	120.00	43.72	68.48	90.07	99.67
		20	0.67	68.22	132.76	120.00	65.24	93.02	118.25	132.76
		25	0.67	85.66	151.80	101.67	86.33	114.31	144.49	193.82
		30	0.67	103.11	145.11	68.33	105.62	135.12	199.59	221.04
		5	0.67	15.88	14.18	120.00	14.18	14.18	14.18	14.18
		10	0.67	33.32	66.15	120.00	27.65	43.13	61.06	66.15
		15	0.67	50.77	112.02	120.00	45.99	74.75	99.34	112.02
		20	0.67	68.22	139.09	88.33	70.40	104.22	177.08	242.63
		25	0.67	85.66	135.37	58.33	95.91	173.43	-	-
		30	0.67	103.11	44.21	21.67	-	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load













Symbols and designation see Annex D3

Hilti installation channel MQ-41-L

Bending characteristics of the channel at elevated temperatures

Annex D17

Table D18: Calculation-based deformation at elevated temperatures for installation channel MQ-41-L

System [Dimensions in mm]	Load direction	σ_B [N/mm ²]	$V^{(10)}$ -	$F^{(11)}$ [N]	$\delta_{t_{max},B}$ [mm]	$t_{max,B}$ [min]	δ_{30} [mm]	δ_{60} [mm]	δ_{90} [mm]	δ_{120} [mm]
		5	0.5	39.61	14.39	120.00	14.39	14.39	14.39	14.39
		10	0.5	86.13	80.97	120.00	30.31	50.69	74.06	80.97
		15	0.5	132.66	171.66	120.00	51.70	101.41	150.76	171.66
		20	0.5	179.18	220.73	120.00	85.69	158.7	201.48	220.73
		25	0.5	225.71	224.25	76.67	139.47	196.71	-	-
		30	0.5	272.23	45.73	21.67	-	-	-	-
		5	0.5	39.61	14.56	120.00	14.56	14.56	14.56	14.56
		10	0.5	86.13	80.27	120.00	30.82	51.52	74.01	80.27
		15	0.5	132.66	140.18	85.00	52.73	96.30	226.49	-
		20	0.5	179.18	137.20	50.00	83.88	-	-	-
		25	0.5	225.71	116.09	28.34	-	-	-	-
		30	0.5	272.23	47.12	21.67	-	-	-	-
		5	0.89	89.12	32.32	120.00	19.05	21.75	30.48	32.32
		10	0.89	193.80	67.26	51.67	46.67	-	-	-
		15	0.89	298.48	21.82	21.67	-	-	-	-
		20	0.89	403.16	18.11	20.01	-	-	-	-
		25	0.89	507.84	15.24	18.34	-	-	-	-
		30	0.89	612.52	25.19	18.34	-	-	-	-
		5	0.89	89.12	26.31	120.00	19.31	21.16	25.47	26.31
		10	0.89	193.80	97.23	120.00	45.31	71.20	90.74	97.23
		15	0.89	298.48	132.36	120.00	72.27	100.77	123.03	132.36
		20	0.89	403.16	128.84	66.67	97.26	123.18	-	-
		25	0.89	507.84	126.62	36.67	116.29	-	-	-
		30	0.89	612.52	118.56	26.67	-	-	-	-
		5	0.67	8.91	20.54	120.00	17.40	17.40	19.78	20.54
		10	0.67	19.38	89.80	120.00	38.11	61.80	83.02	89.80
		15	0.67	29.85	131.42	120.00	62.44	94.92	120.43	131.42
		20	0.67	40.32	164.59	120.00	89.00	122.22	149.97	164.59
		25	0.67	50.78	193.82	120.00	112.32	145.10	175.88	193.82
		30	0.67	61.25	221.04	120.00	132.59	165.24	199.59	221.04
		5	0.67	8.91	20.85	120.00	17.44	17.44	20.10	20.85
		10	0.67	19.38	97.51	120.00	39.44	66.63	90.25	97.51
		15	0.67	29.85	147.48	120.00	66.73	104.99	133.86	147.48
		20	0.67	40.32	197.74	115.00	97.67	138.76	177.08	242.63
		25	0.67	50.78	188.91	70.00	126.55	173.43	-	-
		30	0.67	61.25	31.61	20.01	-	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41-L

Bending characteristics of the channel at elevated temperatures

Annex D18

Table D19: Calculation-based deformation at elevated temperatures for installation channel MQ-41-L

System [Dimensions in mm]	Load-direction	σ_B	$V^{10)}$	$F^{11)}$	$\delta_{t_{max},B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	29.61	17.10	120.00	17.10	17.10	17.10	17.10
		10	0.5	67.68	115.26	120.00	40.78	73.38	104.69	115.26
		15	0.5	105.74	225.59	120.00	70.87	141.32	200.98	225.59
		20	0.5	143.81	284.53	120.00	118.42	210.19	262.44	284.53
		25	0.5	181.87	42.77	21.67	-	-	-	-
		30	0.5	219.94	29.22	20.01	-	-	-	-
		5	0.5	29.61	17.75	120.00	17.36	17.36	17.36	17.75
		10	0.5	67.68	114.21	120.00	41.76	75.23	105.17	114.21
		15	0.5	105.74	180.58	80.00	73.22	131.60	226.49	-
		20	0.5	143.81	174.67	45.00	114.31	-	-	-
		25	0.5	181.87	129.85	26.67	-	-	-	-
		30	0.5	219.94	30.80	20.01	-	-	-	-
		5	0.91	81.43	50.88	120.00	23.53	34.34	47.63	50.88
		10	0.91	186.11	82.29	45.00	64.82	-	-	-
		15	0.91	290.79	30.45	21.67	-	-	-	-
		20	0.91	395.47	25.78	20.01	-	-	-	-
		25	0.91	500.15	20.81	18.34	-	-	-	-
		30	0.91	604.84	17.28	16.67	-	-	-	-
		5	0.91	81.43	36.31	120.00	23.70	29.74	35.12	36.31
		10	0.91	186.11	123.00	120.00	60.30	93.24	115.30	123.00
		15	0.91	290.79	162.89	120.00	92.72	127.1	152.20	162.89
		20	0.91	395.47	159.48	68.33	120.22	151.51	-	-
		25	0.91	500.15	156.33	40.00	141.31	-	-	-
		30	0.91	604.84	150.71	28.34	-	-	-	-
		5	0.67	5.43	32.93	120.00	21.91	25.88	31.77	32.93
		10	0.67	12.41	118.11	120.00	51.85	84.58	109.55	118.11
		15	0.67	19.39	164.18	120.00	82.90	121.75	151.34	164.18
		20	0.67	26.36	197.93	120.00	113.14	151.16	182.27	197.93
		25	0.67	33.34	227.19	120.00	138.33	175.94	209.05	227.19
		30	0.67	40.32	253.24	120.00	159.81	197.23	232.73	253.24
		5	0.67	5.43	32.74	120.00	21.76	25.81	31.58	32.74
		10	0.67	12.41	129.81	120.00	53.93	92.10	120.39	129.81
		15	0.67	19.39	185.84	120.00	89.59	135.91	169.98	185.84
		20	0.67	26.36	242.63	120.00	125.82	174.11	215.99	242.63
		25	0.67	33.34	232.07	71.67	157.76	211.73	-	-
		30	0.67	40.32	44.07	20.01	-	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-41-L

Bending characteristics of the channel at elevated temperatures

Annex D19

English translation prepared by DIBt

Table D20: Calculation-based deformation at elevated temperatures for installation channel MQ-41-L

System [Dimensions in mm]	Load-direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	22.22	24.40	120.00	20.62	20.62	23.18	24.40
		10	0.5	54.43	155.81	120.00	53.44	98.96	138.88	155.81
		15	0.5	86.64	280.67	120.00	92.97	183.12	251.92	280.67
		20	0.5	118.85	351.34	120.00	156.53	262.70	326.19	351.34
		25	0.5	151.06	56.74	21.67	-	-	-	-
		30	0.5	183.27	86.73	21.67	-	-	-	-
		5	0.5	22.22	25.01	120.00	20.68	20.68	23.77	25.01
		10	0.5	54.43	145.27	120.00	54.01	99.39	134.74	145.27
		15	0.5	86.64	239.64	100.00	93.97	162.04	226.49	-
		20	0.5	118.85	227.48	55.00	140.92	-	-	-
		25	0.5	151.06	57.97	21.67	-	-	-	-
		30	0.5	183.27	85.95	21.67	-	-	-	-
		5	0.92	72.21	64.86	120.00	28.97	48.13	61.09	64.86
		10	0.92	176.89	20.07	21.67	-	-	-	-
		15	0.92	281.57	18.16	20.01	-	-	-	-
		20	0.92	386.25	17.42	18.34	-	-	-	-
		25	0.92	490.93	16.95	16.67	-	-	-	-
		30	0.92	595.61	23.07	16.67	-	-	-	-
		5	0.92	72.21	46.99	120.00	28.62	38.89	45.39	46.99
		10	0.92	176.89	150.29	120.00	76.60	116.00	141.07	150.29
		15	0.92	281.57	195.60	120.00	114.30	154.58	183.13	195.60
		20	0.92	386.25	194.74	71.67	144.30	182.05	-	-
		25	0.92	490.93	186.81	41.67	167.60	-	-	-
		30	0.92	595.61	177.80	28.34	-	-	-	-
		5	0.67	3.44	49.33	120.00	27.93	38.58	47.61	49.33
		10	0.67	8.42	146.86	120.00	67.87	108.20	136.41	146.86
		15	0.67	13.41	197.59	120.00	104.63	149.12	182.54	197.59
		20	0.67	18.39	233.73	120.00	137.66	180.52	215.95	233.73
		25	0.67	23.38	263.37	120.00	170.28	213.03	243.60	263.37
		30	0.67	28.36	290.53	120.00	187.73	230.21	268.82	290.53
		5	0.67	3.44	46.77	120.00	27.02	36.96	45.19	46.77
		10	0.67	8.42	159.31	120.00	69.93	117.04	148.59	159.31
		15	0.67	13.41	218.58	120.00	112.04	164.69	202.29	218.58
		20	0.67	18.39	266.02	120.00	151.36	204.02	244.90	266.02
		25	0.67	23.38	268.40	73.33	187.15	246.92	-	-
		30	0.67	28.36	111.20	21.67	-	-	-	-

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load









Symbols and designation see Annex D3

Hilti installation channel MQ-41-L

Bending characteristics of the channel at elevated temperatures

Annex D20

Table D21: Calculation-based deformation at elevated temperatures for installation channel MQ-21.5

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	50.93	35.90	120.00	0.78	16.18	35.66	35.90
		10	0.5	103.51	41.97	120.00	2.41	20.30	41.48	41.97
		15	0.5	156.08	50.47	120.00	4.17	25.12	48.98	50.47
		20	0.5	208.66	63.64	120.00	6.62	31.73	59.30	63.64
		25	0.5	261.24	74.39	120.00	9.74	38.50	68.40	74.39
		30	0.5	313.82	83.86	120.00	13.10	44.68	76.57	83.86
		5	0.5	50.93	36.31	120.00	0.93	16.52	36.05	36.31
		10	0.5	103.51	43.42	120.00	2.77	21.19	42.80	43.42
		15	0.5	156.08	54.41	120.00	4.88	27.04	52.11	54.41
		20	0.5	208.66	70.06	120.00	7.75	34.64	64.27	70.06
		25	0.5	261.24	82.33	113.33	11.45	42.65	75.48	120.75
		30	0.5	313.82	81.67	86.67	16.13	50.45	124.59	137.97
		5	0.67	38.2	36.89	120.00	1.17	17.05	36.62	36.89
		10	0.67	77.63	45.83	120.00	3.31	22.57	44.97	45.83
		15	0.67	117.06	58.77	120.00	5.82	29.52	55.58	58.77
		20	0.67	156.5	71.53	120.00	9.62	37.44	66.21	71.53
		25	0.67	195.93	81.04	120.00	13.74	44.38	74.82	81.04
		30	0.67	235.36	89.52	120.00	19.59	50.50	82.16	89.52
		5	0.67	38.2	37.36	120.00	1.35	17.44	37.07	37.36
		10	0.67	77.63	47.56	120.00	3.75	23.70	46.61	47.56
		15	0.67	117.06	62.66	120.00	6.71	31.95	59.10	62.66
		20	0.67	156.5	77.13	120.00	11.11	41.12	71.29	77.13
		25	0.67	195.93	87.84	120.00	15.97	49.17	80.99	87.84
		30	0.67	235.36	96.75	120.00	23.04	56.32	89.43	96.75

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-21.5

Bending characteristics of the channel at elevated temperatures

Annex D21

Table D22: Calculation-based deformation at elevated temperatures for installation channel MQ-21.5

System [Dimensions in mm]	Load direction	σ_B	$V^{10)}$	$F^{11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	28.80	38.56	120	2.27	18.42	38.12	38.56
		10	0.5	60.35	55.26	120	6.78	29.72	54.09	55.26
		15	0.5	91.89	75.41	120	11.65	42.14	71.81	75.41
		20	0.5	123.44	96.70	120	18.46	55.66	89.49	96.70
		25	0.5	154.99	113.39	120	26.10	67.52	103.94	113.39
		30	0.5	186.53	128.30	120	34.30	77.91	116.97	128.3
		5	0.5	28.80	38.97	120	2.42	18.77	38.51	38.97
		10	0.5	60.35	56.87	120	7.15	30.70	55.57	56.87
		15	0.5	91.89	79.20	120	12.45	44.18	74.89	79.20
		20	0.5	123.44	102.39	120	19.77	58.6	93.99	102.39
		25	0.5	154.99	120.75	120	27.99	71.25	109.85	120.75
		30	0.5	186.53	137.97	120	37.11	82.73	124.59	137.97
		5	0.80	36.00	42.70	120	3.89	22.04	42.14	42.70
		10	0.80	75.43	67.72	120	10.62	38.23	65.44	67.72
		15	0.80	114.86	86.05	120	18.48	52.16	81.68	86.05
		20	0.80	154.30	101.46	120	28.53	64.07	95.19	101.46
		25	0.80	193.73	113.54	120	36.97	73.50	106.03	113.54
		30	0.80	233.16	123.53	120	44.64	81.41	115.08	123.53
		5	0.80	36.00	42.99	120	4.01	22.29	42.41	42.99
		10	0.80	75.43	68.61	120	10.95	39.02	66.35	68.61
		15	0.80	114.86	86.95	120	19.09	53.23	82.73	86.95
		20	0.80	154.30	101.46	120	29.44	65.14	95.76	101.46
		25	0.80	193.73	112.58	120	38.16	74.56	106.11	112.58
		30	0.80	233.16	121.50	120	45.82	82.33	114.61	121.50
		5	0.67	12.00	41.09	120	3.29	20.62	40.56	41.09
		10	0.67	25.14	62.83	120	9.02	34.66	60.92	62.83
		15	0.67	38.29	82.20	120	15.38	47.97	77.85	82.20
		20	0.67	51.43	99.29	120	24.04	60.29	92.53	99.29
		25	0.67	64.58	112.50	120	32.26	70.41	104.25	112.50
		30	0.67	77.72	123.34	120	40.24	79.04	114.13	123.34
		5	0.67	12.00	41.45	120	3.43	20.93	40.92	41.45
		10	0.67	25.14	65.08	120	9.53	36.28	63.16	65.08
		15	0.67	38.29	86.83	120	16.61	51.22	82.04	86.83
		20	0.67	51.43	105.54	120	26.14	64.66	98.14	105.54
		25	0.67	64.58	120.13	120	35.15	75.80	111.17	120.13
		30	0.67	77.72	132.38	120	44.49	85.43	122.39	132.38

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-21.5

Bending characteristics of the channel at elevated temperatures

Annex D22

Table D23: Calculation-based deformation at elevated temperatures for installation channel MQ-21.5

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max},B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	18.69	42.87	120	4.66	22.06	42.11	42.87
		10	0.5	41.22	74.36	120	13.52	43.69	72.19	74.36
		15	0.5	63.75	104.04	120	23.00	63.98	98.56	104.04
		20	0.5	86.29	130.51	120	35.11	82.48	121.10	130.51
		25	0.5	108.82	153.08	120	47.32	98.46	140.66	153.08
		30	0.5	131.35	174.34	120	59.20	112.91	159.25	174.34
		5	0.5	18.69	43.40	120	4.84	22.51	42.62	43.40
		10	0.5	41.22	76.38	120	14.02	44.91	74.00	76.38
		15	0.5	63.75	108.46	120	23.97	66.31	102.11	108.46
		20	0.5	86.29	137.93	120	36.79	86.23	126.89	137.93
		25	0.5	108.82	162.90	120	49.70	103.6	148.57	162.9
		30	0.5	131.35	187.15	120	62.72	119.45	169.73	187.15
		5	0.86	32.70	50.60	120	7.76	28.86	49.62	50.60
		10	0.86	72.14	89.24	120	20.84	55.64	85.67	89.24
		15	0.86	111.57	111.23	120	33.73	72.83	105.44	111.23
		20	0.86	151.00	127.15	120	47.68	86.66	120.00	127.15
		25	0.86	190.44	140.99	120	58.93	98.17	132.62	140.99
		30	0.86	229.87	153.09	120	68.00	107.86	143.64	153.09
		5	0.86	32.70	50.88	120	7.91	29.12	49.88	50.88
		10	0.86	72.14	89.61	120	21.25	56.31	86.14	89.61
		15	0.86	111.57	111.33	120	34.31	73.48	105.72	111.33
		20	0.86	151.00	126.48	120	48.23	86.82	119.71	126.48
		25	0.86	190.44	138.61	120	59.41	97.81	131.17	138.61
		30	0.86	229.87	148.70	120	68.43	106.94	140.90	148.70
		5	0.67	5.45	48.50	120	6.85	26.86	47.57	48.50
		10	0.67	12.02	83.79	120	17.68	50.71	80.55	83.79
		15	0.67	18.59	107.65	120	28.74	68.63	101.88	107.65
		20	0.67	25.17	126.88	120	41.79	83.83	118.85	126.88
		25	0.67	31.74	143.21	120	53.33	96.53	133.38	143.21
		30	0.67	38.31	156.98	120	63.07	107.34	145.85	156.98
		5	0.67	5.45	48.87	120	6.96	27.19	47.94	48.87
		10	0.67	12.02	87.69	120	18.60	53.55	84.37	87.69
		15	0.67	18.59	114.39	120	31.05	73.73	108.10	114.39
		20	0.67	25.17	136.65	120	45.66	90.78	127.59	136.65
		25	0.67	31.74	155.27	120	58.34	105.08	144.28	155.27
		30	0.67	38.31	171.28	120	69.47	117.53	158.93	171.28

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

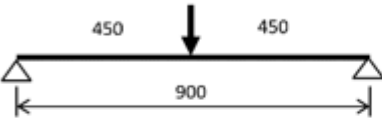

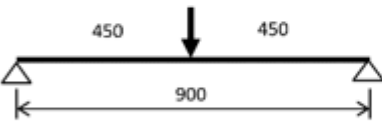

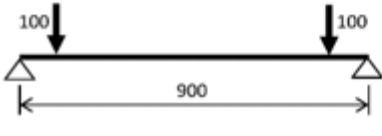

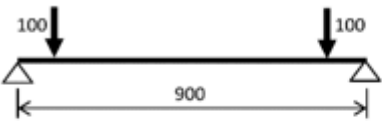

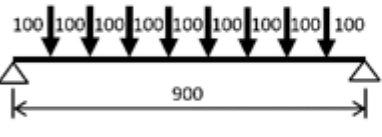

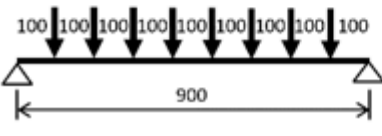

Hilti installation channel MQ-21.5

Bending characteristics of the channel at elevated temperatures

Annex D23

English translation prepared by DIBt

Table D24: Calculation-based deformation at elevated temperatures for installation channel MQ-21.5

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(1)}$	$\delta_{max;B}$	$t_{max;B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	12.58	49.30	120	8.15	27.51	48.11	49.30
		10	0.5	30.11	97.00	120	22.72	61.15	93.67	97.00
		15	0.5	47.63	133.93	120	37.51	87.74	126.71	133.93
		20	0.5	65.16	166.00	120	54.52	110.89	154.42	166.00
		25	0.5	82.68	195.66	120	70.96	131.59	180.33	195.66
		30	0.5	100.21	224.81	120	85.93	151.20	206.06	224.81
		5	0.5	12.58	50.15	120	8.43	28.22	48.92	50.15
		10	0.5	30.11	100.38	120	23.50	63.05	96.58	100.38
		15	0.5	47.63	140.68	120	39.17	91.52	132.14	140.68
		20	0.5	65.16	176.76	120	57.49	116.62	162.83	176.76
		25	0.5	82.68	210.43	120	74.93	139.19	191.89	210.43
		30	0.5	100.21	246.64	120	91.48	160.73	222.17	246.64
		5	0.89	28.31	59.71	120	12.57	36.75	58.19	59.71
		10	0.89	67.74	109.76	120	33.00	73.01	105.00	109.76
		15	0.89	107.17	136.23	120	49.91	93.70	128.83	136.23
		20	0.89	146.61	155.10	120	66.20	109.16	146.16	155.10
		25	0.89	186.04	170.24	120	79.48	122.17	160.26	170.24
		30	0.89	225.47	183.31	120	90.35	133.58	172.51	183.31
		5	0.89	28.31	60.01	120	12.81	37.04	58.47	60.01
		10	0.89	67.74	109.90	120	33.61	73.67	105.30	109.90
		15	0.89	107.17	135.71	120	50.61	94.18	128.64	135.71
		20	0.89	146.61	153.73	120	66.66	109.25	145.32	153.73
		25	0.89	186.04	167.79	120	79.68	121.48	158.60	167.79
		30	0.89	225.47	179.25	120	90.29	132.01	169.69	179.25
		5	0.67	2.83	60.12	120	12.26	36.47	58.61	60.12
		10	0.67	6.77	106.43	120	29.17	68.93	101.71	106.43
		15	0.67	10.72	134.39	120	44.68	90.24	126.82	134.39
		20	0.67	14.66	155.11	120	60.88	107.38	145.56	155.11
		25	0.67	18.60	173.28	120	74.92	122.17	161.93	173.28
		30	0.67	22.55	189.33	120	86.68	134.97	176.48	189.33
		5	0.67	2.83	60.06	120	12.17	36.48	58.56	60.06
		10	0.67	6.77	112.27	120	30.64	73.32	107.41	112.27
		15	0.67	10.72	143.63	120	48.42	97.53	135.54	143.63
		20	0.67	14.66	168.45	120	66.87	117.58	157.76	168.45
		25	0.67	18.60	190.50	120	82.58	134.83	177.65	190.50
		30	0.67	22.55	210.11	120	95.88	150.19	195.66	210.11

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-21.5

Bending characteristics of the channel at elevated temperatures

Annex D24

Table D25: Calculation-based deformation at elevated temperatures for installation channel MQ-21.5

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(1)}$	$\delta_{tmax,B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	8.30	58.35	120	12.96	35.24	56.58	58.35
		10	0.5	22.64	121.75	120	34.22	80.87	117.12	121.75
		15	0.5	36.97	165.83	120	54.34	113.17	156.63	165.83
		20	0.5	51.31	203.81	120	75.93	141.19	189.97	203.81
		25	0.5	65.65	241.63	120	96.43	167.46	223.46	241.63
		30	0.5	79.99	279.41	120	114.70	193.19	257.28	279.41
		5	0.5	8.30	59.5	120	13.32	36.14	57.68	59.50
		10	0.5	22.64	126.67	120	35.42	83.71	121.31	126.67
		15	0.5	36.97	173.94	120	56.99	118.18	163.33	173.94
		20	0.5	51.31	216.43	120	80.25	148.38	199.96	216.43
		25	0.5	65.65	259.67	120	101.84	176.81	237.55	259.67
		30	0.5	79.99	306.71	120	121.67	204.71	276.92	306.71
		5	0.91	22.82	69.26	120	18.02	45.01	67.13	69.26
		10	0.91	62.25	130.23	120	46.19	90.30	124.29	130.23
		15	0.91	101.68	161.70	120	66.83	114.64	152.57	161.7
		20	0.91	141.11	184.01	120	84.63	132.70	173.07	184.01
		25	0.91	180.55	201.82	120	99.75	147.39	189.68	201.82
		30	0.91	219.98	216.89	120	112.34	160.17	203.86	216.89
		5	0.91	22.82	68.61	120	17.85	44.48	66.48	68.61
		10	0.91	62.25	130.13	120	46.22	90.65	124.46	130.13
		15	0.91	101.68	160.84	120	67.02	114.88	152.17	160.84
		20	0.91	141.11	182.13	120	84.68	132.58	171.88	182.13
		25	0.91	180.55	198.81	120	99.68	146.72	187.62	198.81
		30	0.91	219.98	212.34	120	111.95	158.70	200.66	212.34
		5	0.67	1.52	76.47	120	19.98	49.77	74.18	76.47
		10	0.67	4.15	129.94	120	43.13	88.32	123.64	129.94
		15	0.67	6.78	161.32	120	62.26	112.41	151.87	161.32
		20	0.67	9.41	184.3	120	80.57	131.16	172.82	184.30
		25	0.67	12.04	203.64	120	96.48	147.46	190.54	203.64
		30	0.67	14.67	221.15	120	110.01	161.97	206.58	221.15
		5	0.67	1.52	75.34	120	19.33	49.06	73.09	75.34
		10	0.67	4.15	137.72	120	45.18	94.29	131.24	137.72
		15	0.67	6.78	173.66	120	67.46	122.15	163.62	173.66
		20	0.67	9.41	201.15	120	88.83	144.74	188.65	201.15
		25	0.67	12.04	225.91	120	107.07	164.77	211.23	225.91
		30	0.67	14.67	248.49	120	122.64	182.8	232.05	248.49

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-21.5

Bending characteristics of the channel at elevated temperatures

Annex D25

Table D26: Calculation-based deformation at elevated temperatures for installation channel MQ-21.5

System [Dimensions in mm]	Load direction	σ_B	$V^{(10)}$	$F^{(11)}$	$\delta_{t_{max};B}$	$t_{max,B}$	δ_{30}	δ_{60}	δ_{90}	δ_{120}
		[N/mm ²]	-	[N]	[mm]	[min]	[mm]	[mm]	[mm]	[mm]
		5	0.5	4.99	70.37	120	19.34	45.57	67.88	70.37
		10	0.5	17.12	148.28	120	47.84	102.40	142.18	148.28
		15	0.5	29.26	199.68	120	73.17	140.21	188.29	199.68
		20	0.5	41.39	244.11	120	98.98	173.42	227.91	244.11
		25	0.5	53.52	290.84	120	123.4	206.14	269.93	290.84
		30	0.5	65.66	337.33	120	145.42	238.51	312.15	337.33
		5	0.5	4.99	69.03	120	18.76	44.41	66.57	69.03
		10	0.5	17.12	148.92	120	47.55	102.68	142.83	148.92
		15	0.5	29.26	201.38	120	73.31	141.42	190.02	201.38
		20	0.5	41.39	245.28	120	99.88	175.08	229.31	245.28
		25	0.5	53.52	292.46	120	124.89	208.20	271.64	292.46
		30	0.5	65.66	338.82	120	147.19	240.38	313.45	338.82
		5	0.92	16.22	78.87	120	23.79	53.24	76.05	78.87
		10	0.92	55.66	151.53	120	59.88	107.99	144.35	151.53
		15	0.92	95.09	188.56	120	84.35	136.35	177.57	188.56
		20	0.92	134.52	214.56	120	103.59	157.21	201.46	214.56
		25	0.92	173.96	235.27	120	120.49	174.14	220.79	235.27
		30	0.92	213.39	252.73	120	134.83	188.67	237.23	252.73
		5	0.92	16.22	78.02	120	23.41	52.52	75.22	78.02
		10	0.92	55.66	152.1	120	59.93	108.82	145.22	152.10
		15	0.92	95.09	188.14	120	84.74	136.95	177.70	188.14
		20	0.92	134.52	212.89	120	103.82	157.33	200.59	212.89
		25	0.92	173.96	232.30	120	120.54	173.71	218.88	232.30
		30	0.92	213.39	248.10	120	134.54	187.49	234.07	248.10
		5	0.67	0.77	96.8	120	30.36	66.32	93.51	96.80
		10	0.67	2.65	154.08	120	59.03	108.42	146.12	154.08
		15	0.67	4.53	188.24	120	80.96	134.78	176.91	188.24
		20	0.67	6.41	213.68	120	100.64	155.24	200.14	213.68
		25	0.67	8.28	234.66	120	117.97	172.76	219.49	234.66
		30	0.67	10.16	253.24	120	132.93	188.58	236.72	253.24
		5	0.67	0.77	91.15	120	27.59	62.56	88.13	91.15
		10	0.67	2.65	160.32	120	59.87	113.66	152.69	160.32
		15	0.67	4.53	200.42	120	84.98	144.67	188.89	200.42
		20	0.67	6.41	230.68	120	108.25	169.16	216.69	230.68
		25	0.67	8.28	256.84	120	128.54	191.19	241.02	256.84
		30	0.67	10.16	281.15	120	146.18	211.36	263.61	281.15

¹⁰⁾ Momentum degree of fullness without contribution from channel dead weight

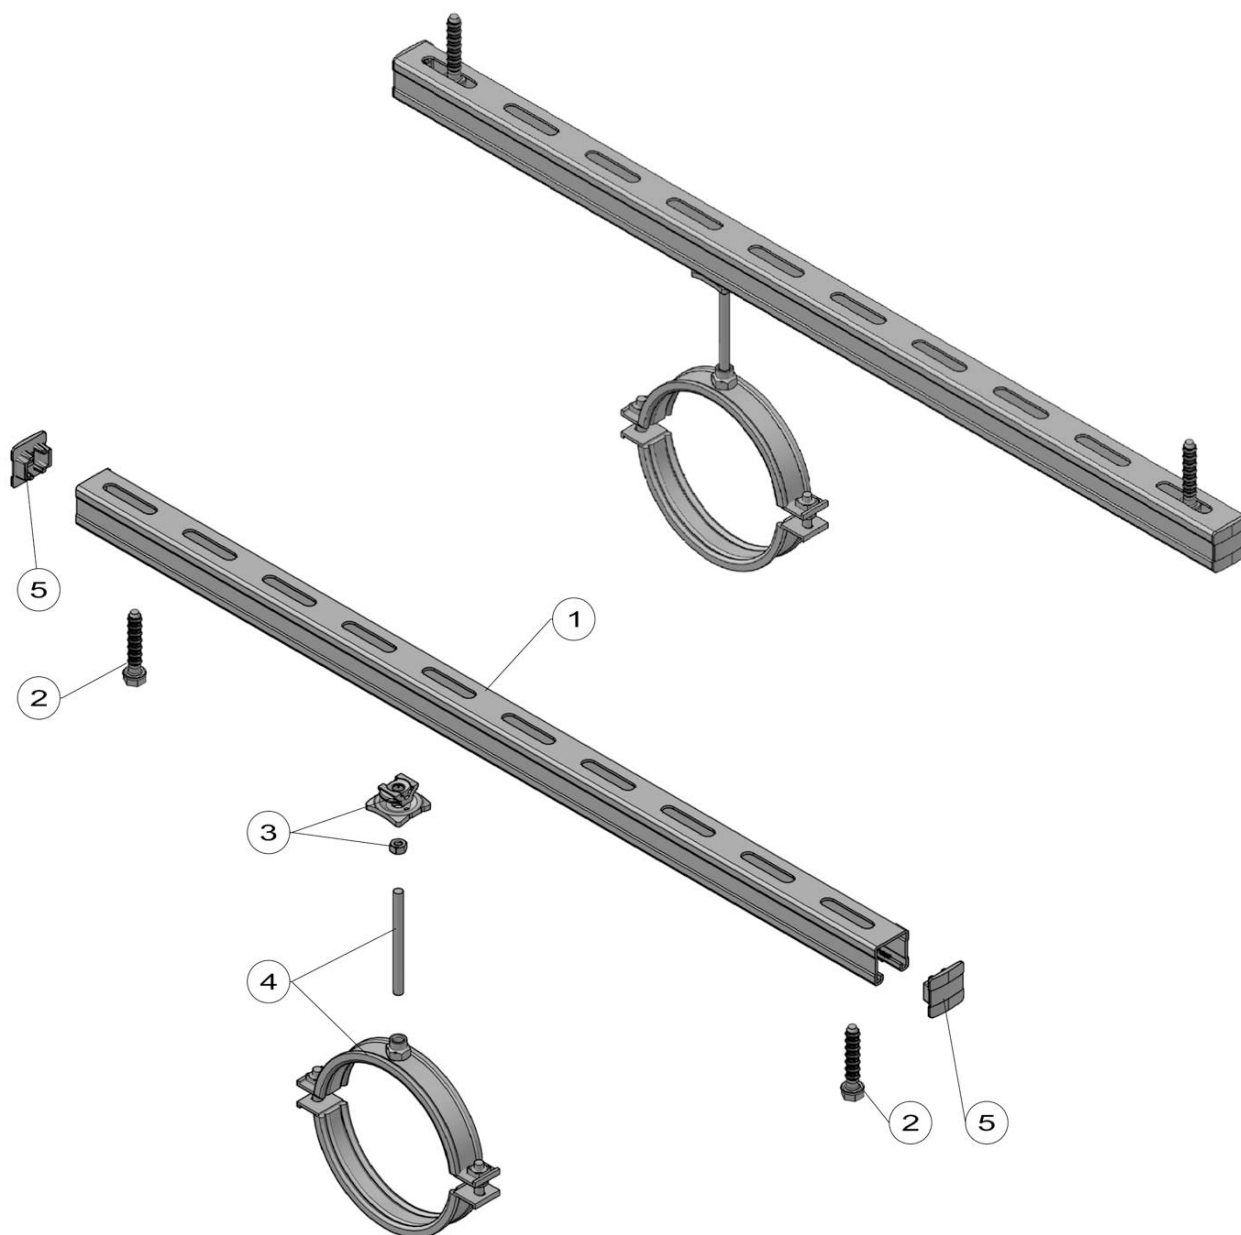
¹¹⁾ Size of the designated system's single load

Symbols and designation see Annex D3

Hilti installation channel MQ-21.5

Bending characteristics of the channel at elevated temperature

Annex D26



Legend

- 1 MQ-41/3 or MQ-41/3 LL
- 2 Fastener to the substructure
- 3 MQA-B with hexagonal nut
- 4 Pipe ring with threaded rod¹²⁾
- 5 MQZ-E41 end cap

¹²⁾ Number, type and variable pipe ring assignments

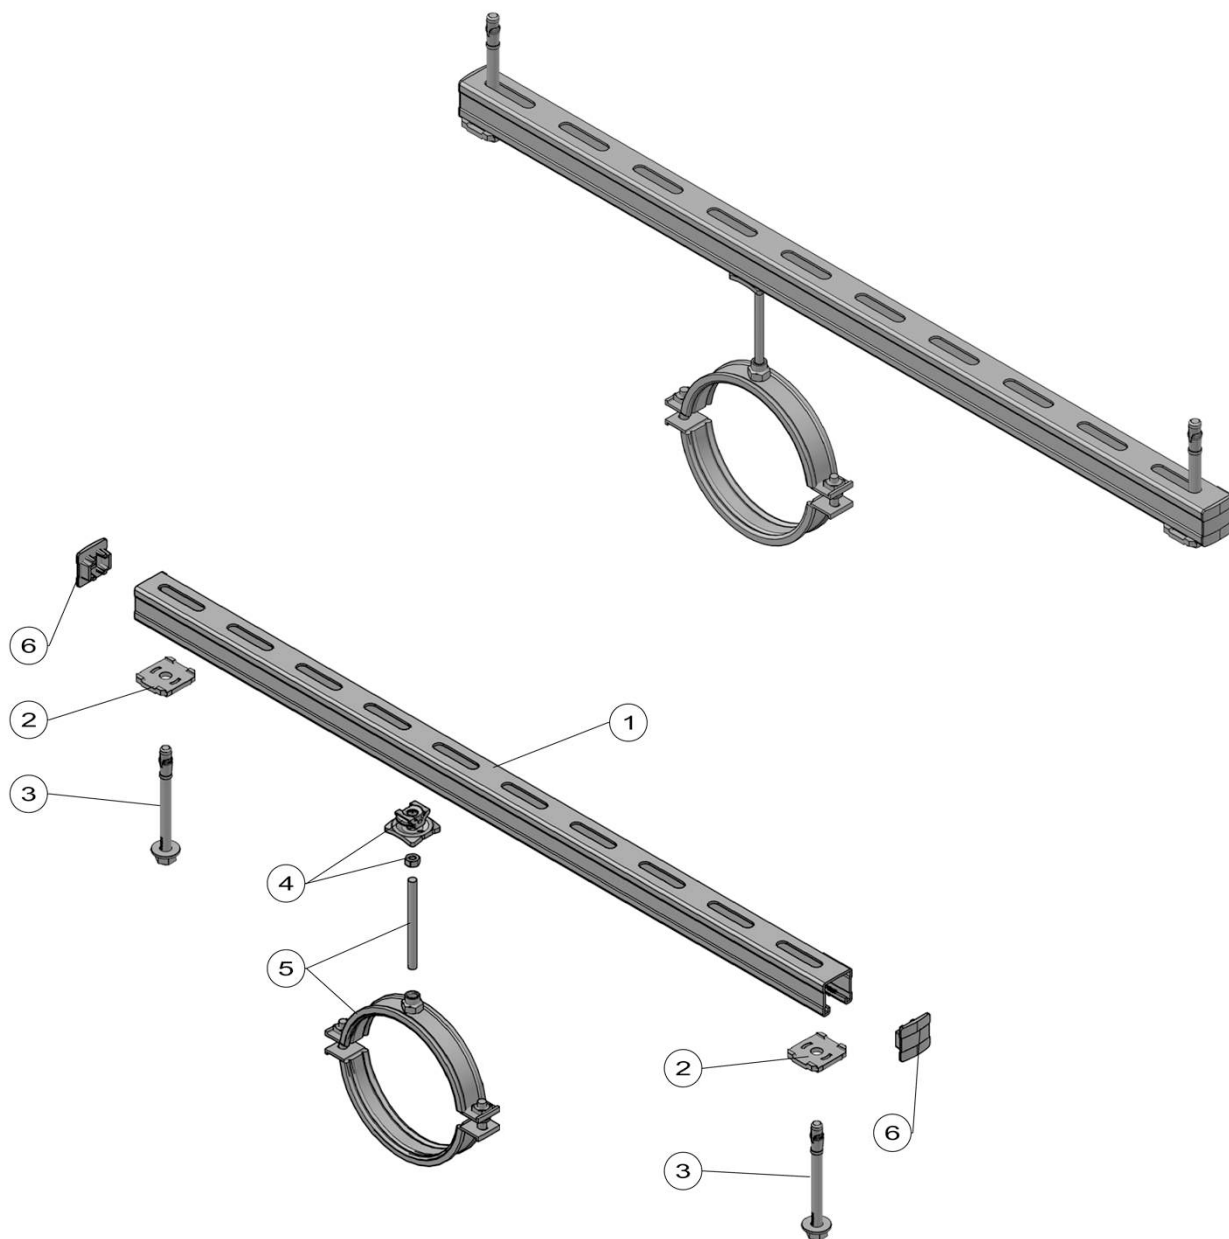
Annex

- A1 not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA

Hilti installation channel MQ-41/3 and MQ-41/3 LL

Headrail installation: Fixation in the back of the channel for use at ambient temperature applications

Annex E1
(informative)



Legend

- 1 MQ-41/3 or MQ-41/3 LL
 - 2 MQZ-L drilled plate
 - 3 Fastener to the substructure
 - 4 MQA-B with hexagonal nut
 - 5 Pipe ring with threaded rod¹²⁾
 - 6 MQZ-E41 end cap
- ¹²⁾ Number, type and variable pipe ring assignments

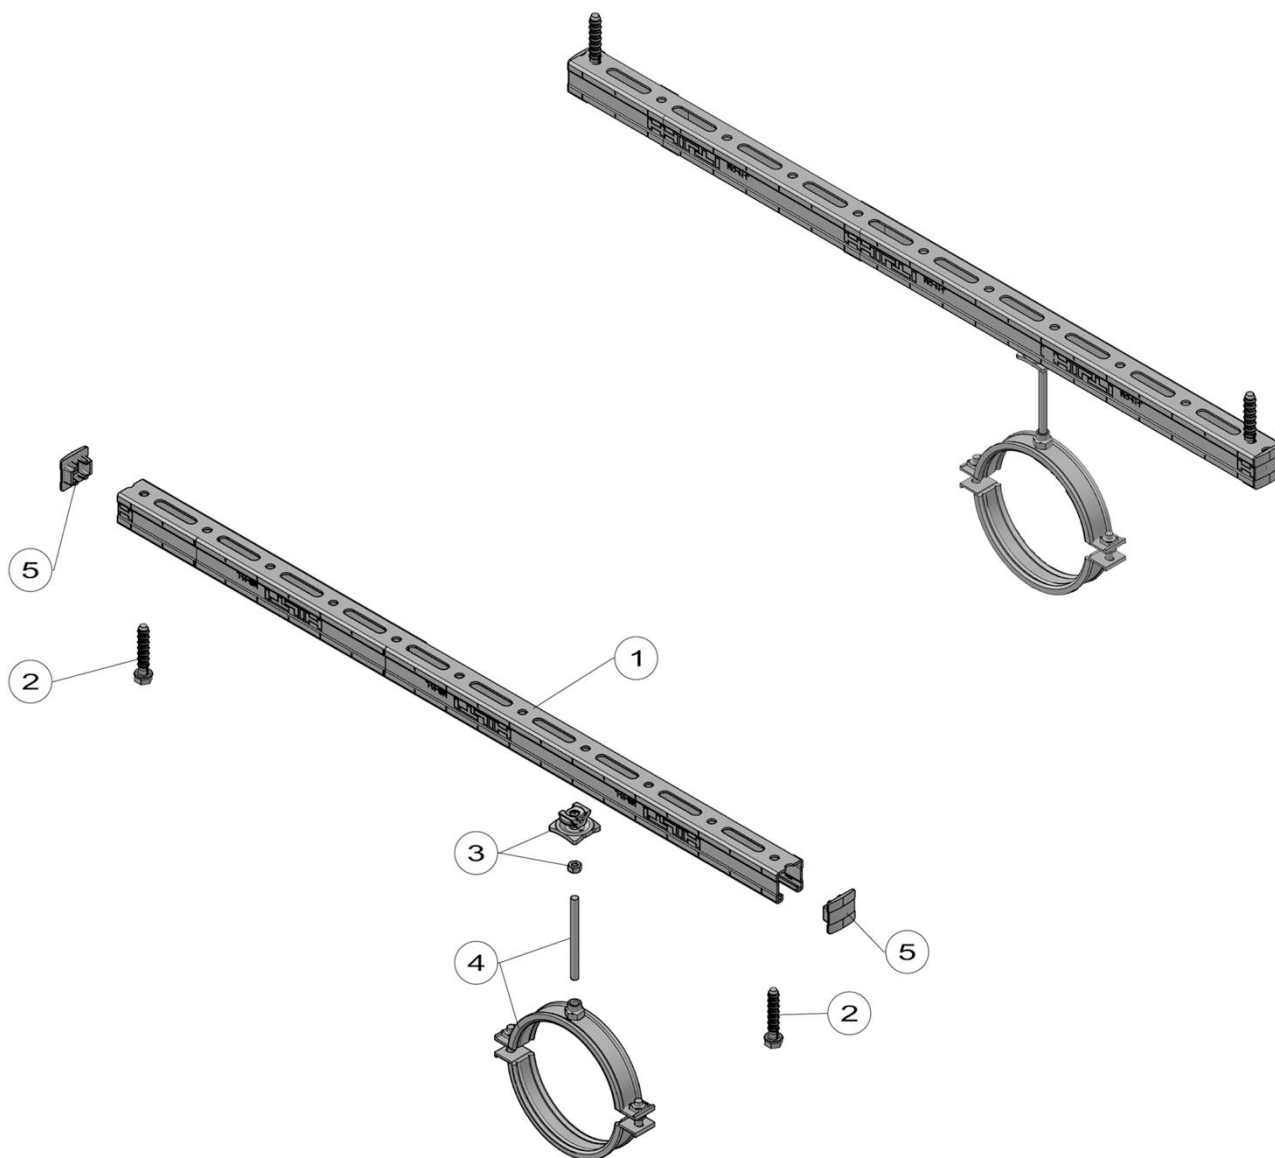
Annex

- A1 not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA

Hilti installation channel MQ-41/3 and MQ-41/3 LL

Headrail installation: Fixation of the channel with MQZ-L drilled plates for use at ambient and elevated temperature applications

Annex E2
(informative)



Legend

- 1 MQ-41, MQ-41-L or MQ-21.5
- 2 Fastener to the substructure
- 3 MQA-B with hexagonal nut
- 5 Pipe ring with threaded rod¹²⁾
- 6 MQZ-E41 or MQZ-E21 end cap

¹²⁾ Number, type and variable pipe ring assignments

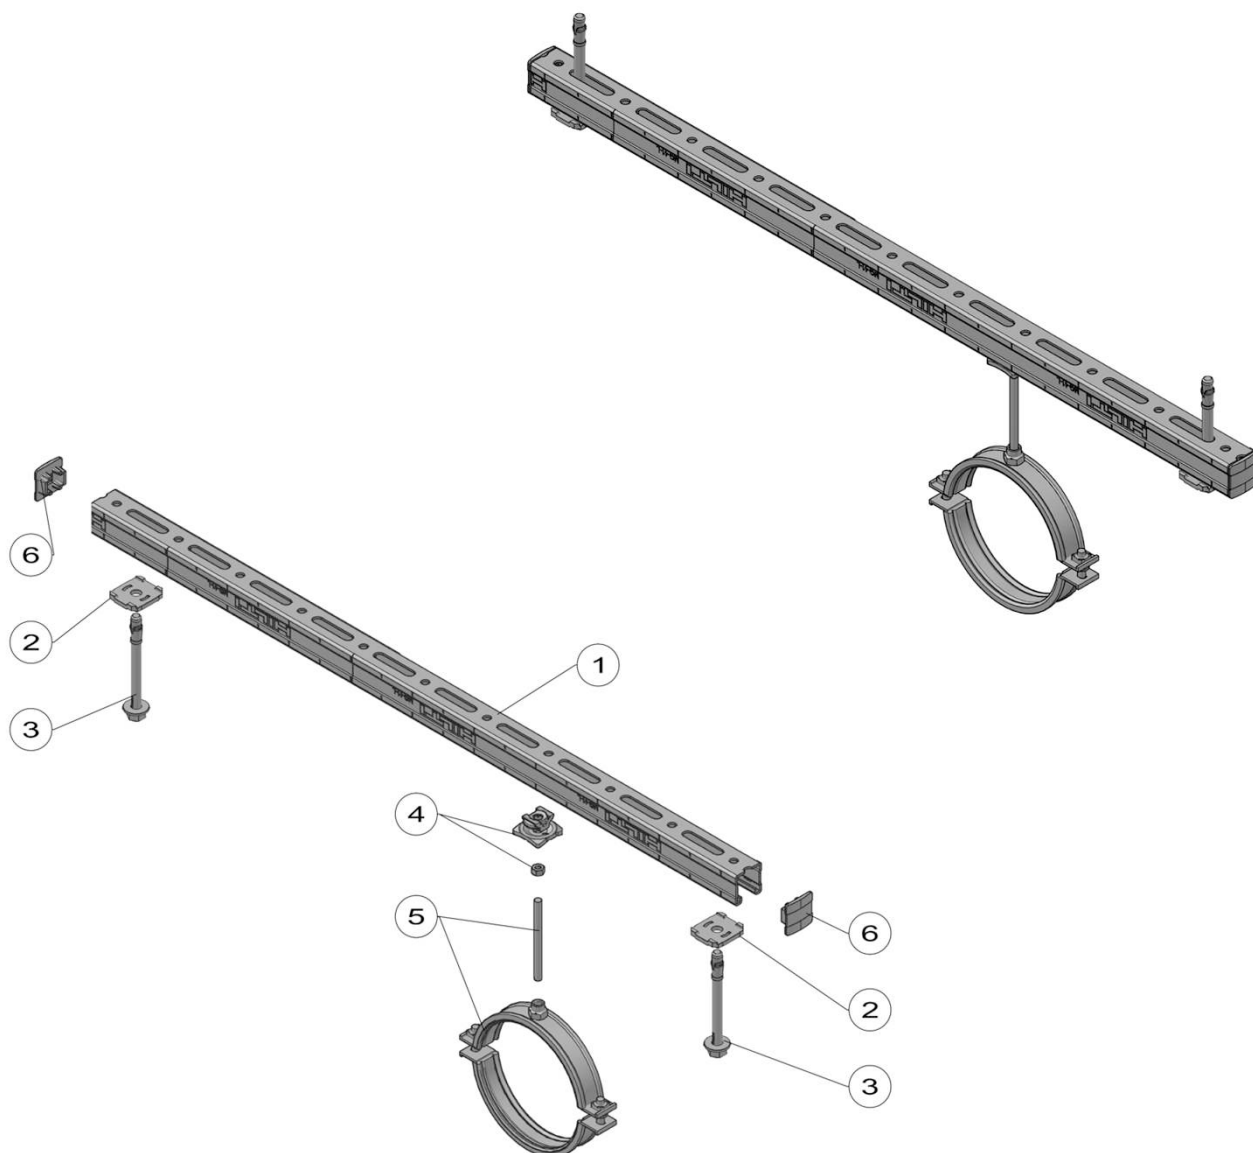
Annex

- A2 not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA

Hilti installation channel MQ-21.5, MQ-41 and MQ-41-L

Headrail installation: Fixation in the back of the channel for use at ambient and elevated temperature applications

Annex E3
(informative)



Legend

- 1 MQ-41, MQ-41-L or MQ-21.5
- 2 MQZ-L drilled plate
- 3 Fastener to the substructure
- 4 MQA-B with hexagonal nut
- 5 Pipe ring with threaded rod¹²⁾
- 6 MQZ-E41 or MQZ-E21 end cap

¹²⁾ Number, type and variable pipe ring assignments

Annex

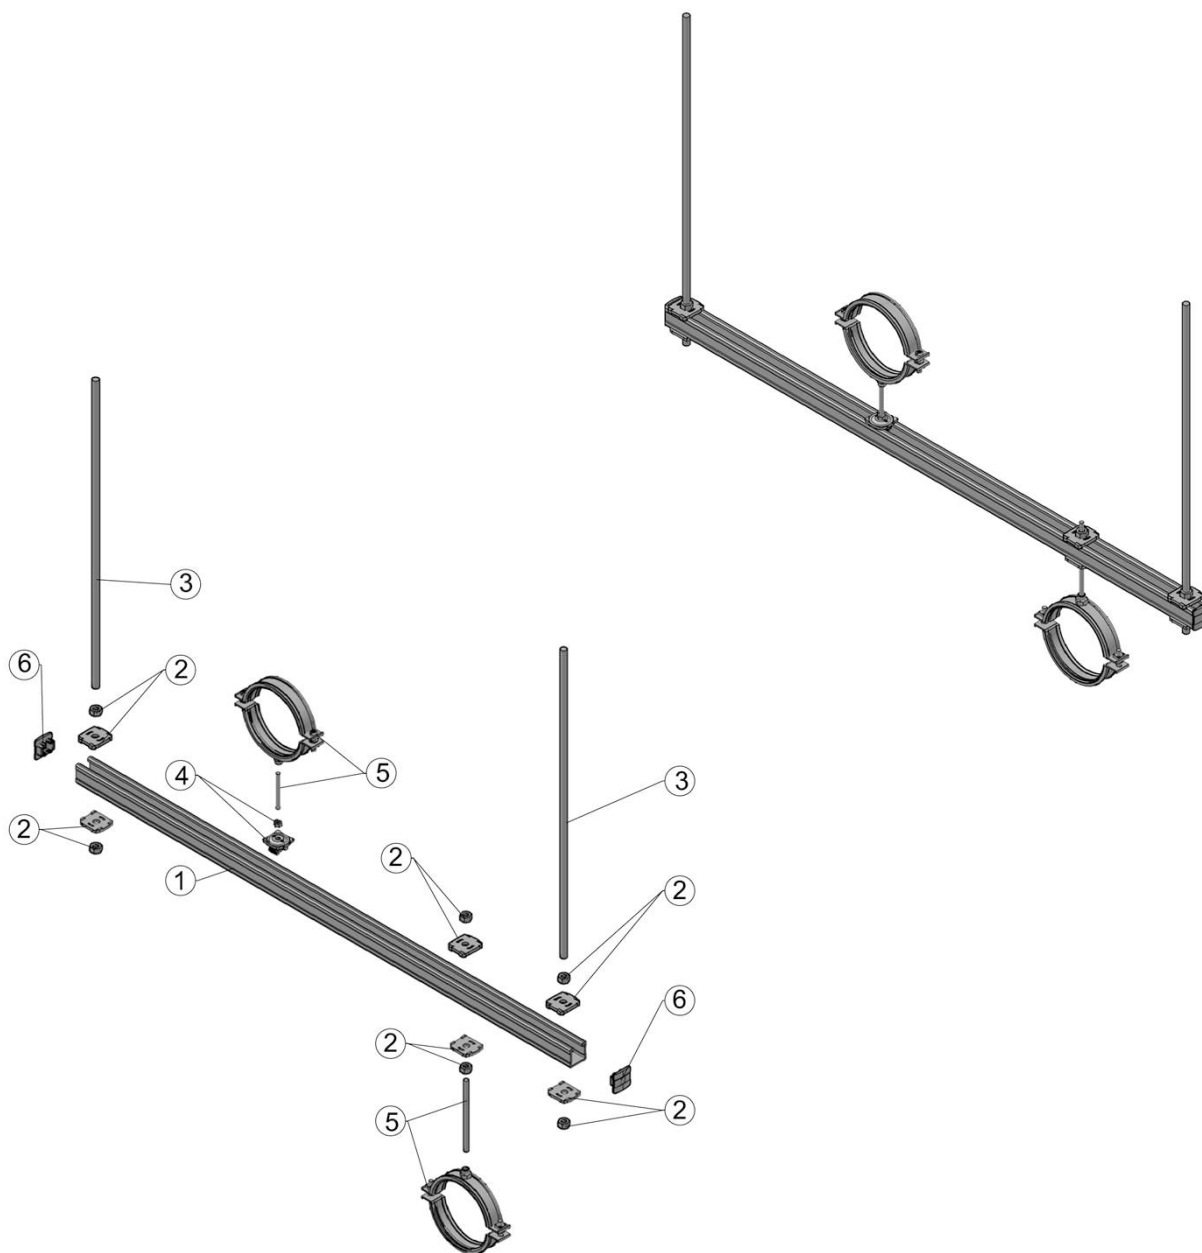
A2

- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA

Hilti installation channel MQ-21.5, MQ-41 and MQ-41-L

Headrail installation: Fixation of the channel with MQZ-L drilled plates for use at ambient and elevated temperature applications

Annex E4
(informative)



Legend

- 1 MQ-41/3, MQ-41/3 LL, MQ-41, MQ-41-L or MQ-21.5
 - 2 MQZ-L with hexagonal nut
 - 3 Threaded rod
 - 4 MQA-B with hexagonal nut
 - 5 Pipe ring with threaded rod¹²⁾
 - 6 MQZ-E41 or MQZ-E21 end cap
- ¹²⁾ Number, type and variable pipe ring assignments

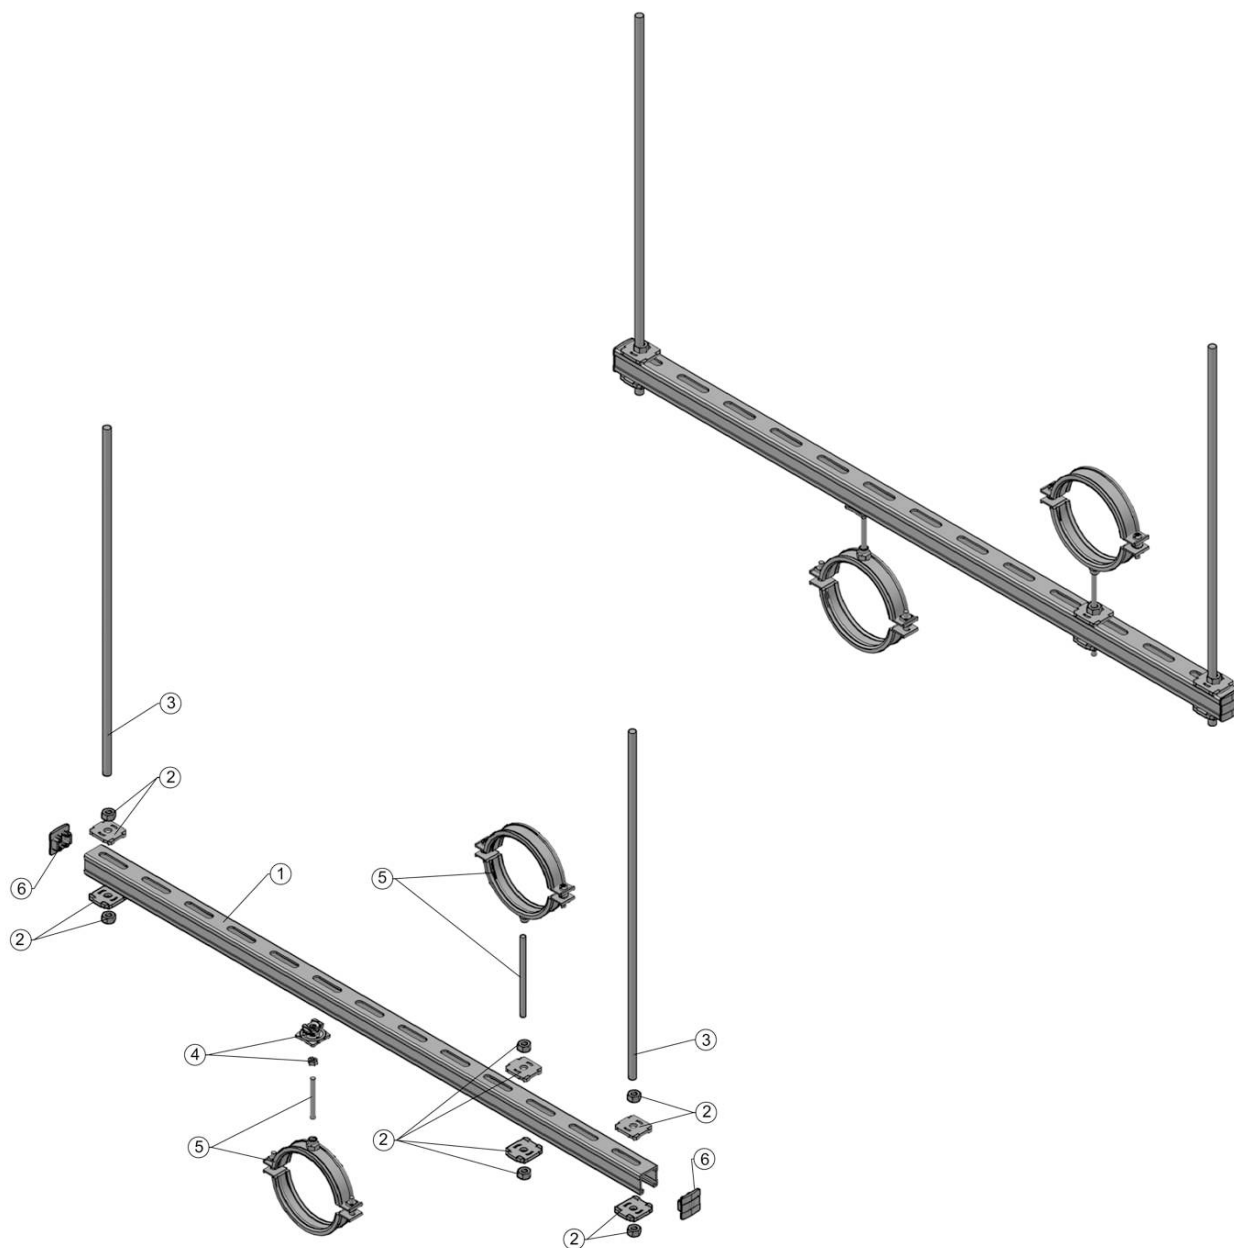
Annex

- A1, A2
- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-21.5, MQ-41 and MQ-41-L

Trapeze rod installation with channel opening at the top

Annex E5
(informative)



Legend

- 1 MQ-41/3, MQ-41/3 LL or MQ-41, MQ-41-L, MQ-21.5
- 2 MQZ-L with hexagonal nut
- 3 Threaded rod
- 4 MQA-B with hexagonal nut
- 5 Pipe ring with threaded rod¹²⁾
- 6 MQZ-E41 or MQZ-E21 end cap

¹²⁾ Number, type and variable pipe ring assignments

Annex

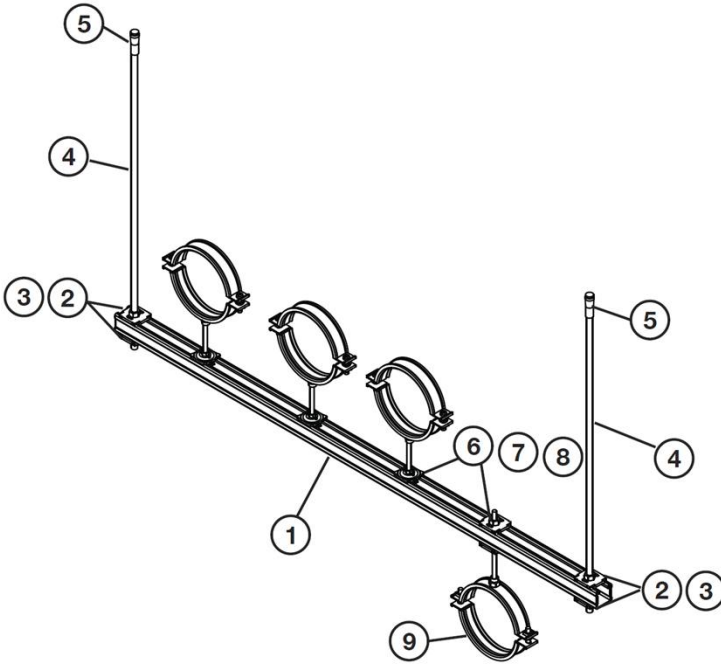
- A1, A2
- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA
- not an integral part of this ETA

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-21.5, MQ-41 and MQ-41-L

Trapeze rod installation with channel opening underneath

Annex E6
(informative)

English translation prepared by DIBt



Bill of material / Stückliste				
Part of typical/ Applikationselement	Ref.	Opt.	Item no. / Artikel Nr.	Description / Bezeichnung
Channel / Schiene	1		2184772	MQ-21.5 3m channel*
	1		369596	MQ-41/3 3m channel*
	1		369591	MQ-41 3m channel*
	1		2141965	MQ-41-L 3m channel*
	1		2148102	MQ-41/3-LL 3m channel*
Structure / Aufbau	2	A	2199455	MQZ-L11 drilled plate
	2	B	2199456	MQZ-L13 drilled plate
Fixation / Befestigung	3	A	216466	M10 hexagon nut
	3	B	216467	M12 hexagon nut
	4	A	339795	AM10x1000 4.8 threaded rod**
	4	B	339797	AM12x1000 4.8 threaded rod**
	5	A	376967	HKD M10x40 drop-in anchor
	B	378544	HKD M12x50 drop-in anchor	
Pipe Fixation / Rohr- fixierung	6	A	2199452	MQA-M10-B piping saddle
	6	B	2199455	MQZ-L11 drilled plate
	7		216466	M10 hexagon nut
	8		339795	AM10x1000 4.8 threaded rod**
	6	A	2199453	MQA-M12-B piping saddle
	6	B	2199456	MQZ-L13 drilled plate
	7		216467	M12 hexagon nut
	8		339797	AM12x1000 4.8 threaded rod**
M16	6		2199454	MQA-M16-B piping saddle
	7		216468	M16 hexagon nut
	8		216422	AM16x1000 4.8 threaded rod**
Pipe Ring / Rohrschelle	M10/ M12/ M16		20843 - 20898	MP-MI (from 3/8" to 244.5C, with M10, 12, 16)

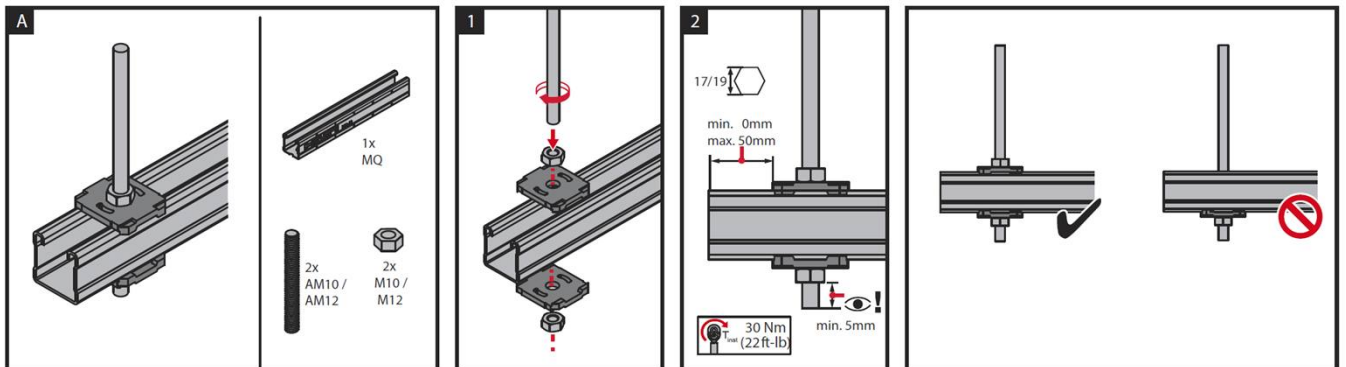
* other length of the channels also possible / * andere Schienenlängen auch möglich
** Threaded rod available in 1, 2 & 3 meters / Gewindestange erhältlich in 1, 2 & 3 Meter

Assembly Instructions / Montagehinweise

1

Please use the Threaded rod & Anchors either in closed long holes or closed round holes in the channel
Verwendung von Gewindestangen und Dübeln nur durch geschlossene Langlöcher bzw. Rundlöcher der Schiene

2 / 3 / 4

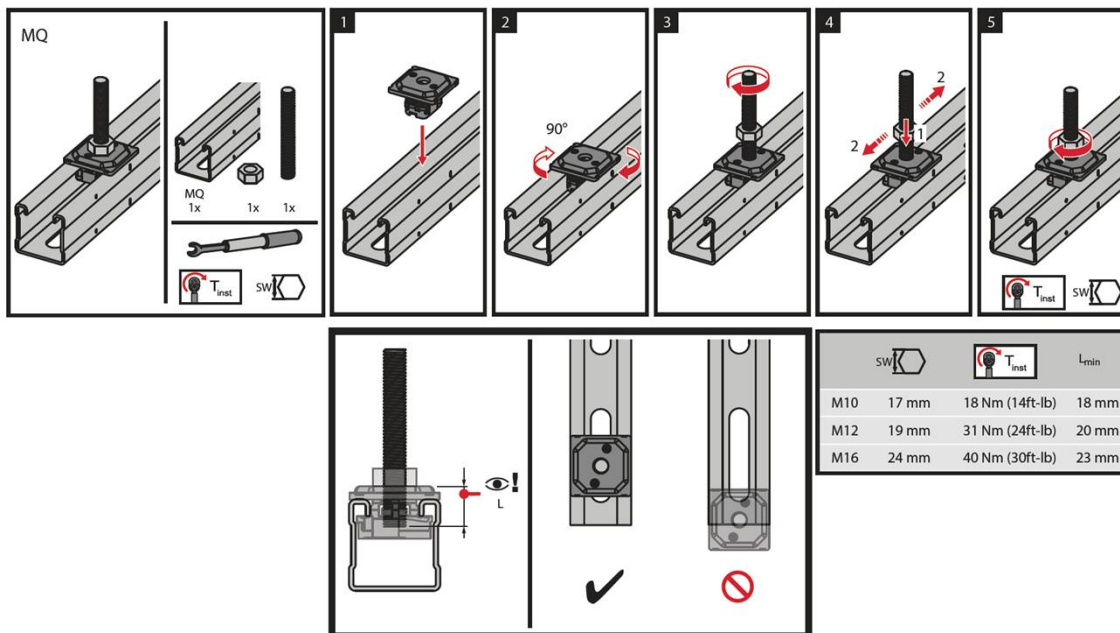


Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-21.5, MQ-41 and MQ-41-L

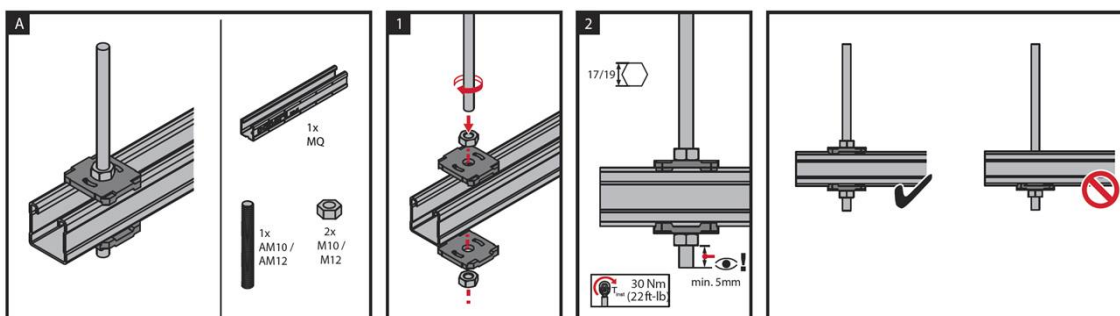
General installation instructions
Trapeze rod with Hilti MQ-41/3, MQ-41/3 LL, MQ-41, MQ-41-L and MQ-21.5

Annex E7
(informative)

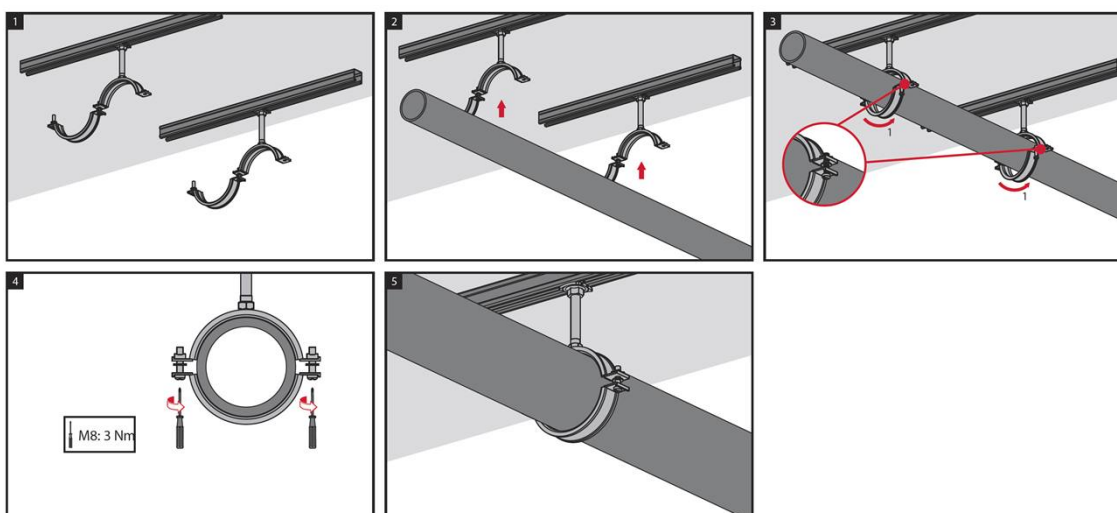
6 / 7 / 8



or / oder



9

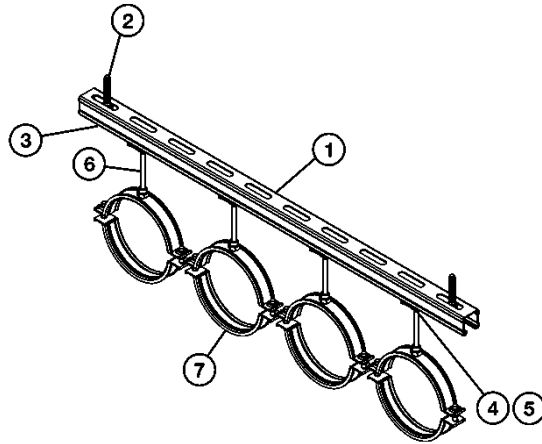


Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-21.5, MQ-41 and MQ-41-L

General installation instructions
Trapeze rod with Hilti MQ-41/3, MQ-41/3 LL, MQ-41, MQ-41-L and MQ-21.5

Annex E8
(informative)

English translation prepared by DIBt



Bill of material for MQ-41/3, MQ-41/3 LL, MQ-41, MQ-41-L:

Bill of material for MQ-21.5:

Bill of material / Stückliste				
Part of typical/ Applikationselement	Ref.	Opt.	Item no. / Artikel Nr.	Description / Bezeichnung
Structure / Aufbau	Channel / Schiene	1	369596	MQ-41/3 3m channel*
		1	2048102	MQ-41/3 LL 3m channel*
		1	2141965	MQ-41-L 3m channel*
		1	369591	MQ-41 3m channel*
Fixation / Befestigung	2	A	2105715	HST3 M10x130 70/50 + MQZ-L11
	2	B	2079798	HUS3 -H 8x100 50/40/30 + MQZ-L11
	3	A	2199455	MQZ-L11 drilled plate
Pipe Fixation / Rohr- fixierung	M10	4	2199452	MQA-M10-B piperig saddle
		5	216466	M10 hexagon nut
		6	339795	AM10x1000 4.8 threaded rod**
	M12	4	2199453	MQA-M12-B piperig saddle
		5	216467	M12 hexagon nut
		6	339797	AM12x1000 4.8 threaded rod**
	M16	4	2199454	MQA-M16-B piperig saddle
		5	216468	M16 hexagon nut
		6	216422	AM16x1000 4.8 threaded rod**
Pipe Ring / Rohrschelle	M10/ M12/ M16	7	20843 - 20898	MP-MI (from 3/8" to 244.5C", with M10, 12, 16)

Bill of material / Stückliste					
Part of typical/ Applikationselement	Ref.	Opt.	Item no. / Artikel Nr.	Description / Bezeichnung	
Structure / Aufbau	Channel / Schiene	1	2184772	MQ-21.5 3m channel*	
		2	A	2079797	HST3 M10x110 50/30 + MQZ-L11
		2	B	2105714	HUS3 -H 8x85 35/25/15 + MQZ-L11
Fixation / Befestigung	3	A	2199455	MQZ-L11 drilled plate	
	Pipe Fixation / Rohr- fixierung	M10	4	2199452	MQA-M10-B piperig saddle
5			216466	M10 hexagon nut	
6			339795	AM10x1000 4.8 threaded rod**	
M12		4	2199453	MQA-M12-B piperig saddle	
		5	216467	M12 hexagon nut	
		6	339797	AM12x1000 4.8 threaded rod**	
M16		4	2199454	MQA-M16-B piperig saddle	
		5	216468	M16 hexagon nut	
		6	216422	AM16x1000 4.8 threaded rod**	
Pipe Ring / Rohrschelle	M10/ M12/ M16	7	A 20843 - 20898	MP-MI (from 3/8" to 244.5C", with M10, 12, 16)	

* other lengths of the channels also possible / * andere Schienenlängen auch möglich

** Threaded rod available in 1,2 & 3 meters / ** Gewindestange erhältlich in 1,2 & 3 Meter

MQ-41/3 and MQ-41/3 LL channels can be also mounted on the base material without using MQZ-L11 drilled plates for use at ambient temperatures with the following fasteners through the longhole:
HUS3-H 10x60 5/-/ (2079911), HST2 M12x105/10 (2107848) or HST3 M12x105 30/10 (2105718).

MQ-21.5, MQ-41 and MQ-41-L channels can be also mounted on the base material without using MQZ-L11 drilled plates for use at ambient and elevated temperatures with the following fasteners through the roundhole:
HUS3-H 8x55 5/-/-(2079794), HST2 M10x90 /10 (2107847) or HST3 M10x90 30/10 (2105712).

The anchoring of the channels to the base material and the base material itself must be suitable to withstand the resistance values of the channels as well as of the installation systems and that they have a fireproof certificate.

Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-21.5, MQ-41 and MQ-41-L

General installation instructions
Headrail with Hilti MQ-41/3, MQ-41/3 LL, MQ-41, MQ-41-L and MQ-21.5

Annex E9
(informative)

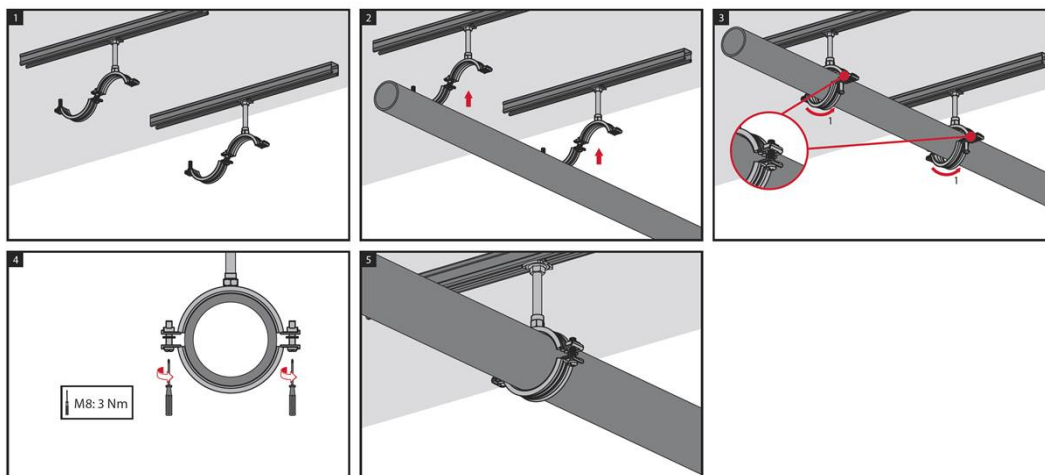
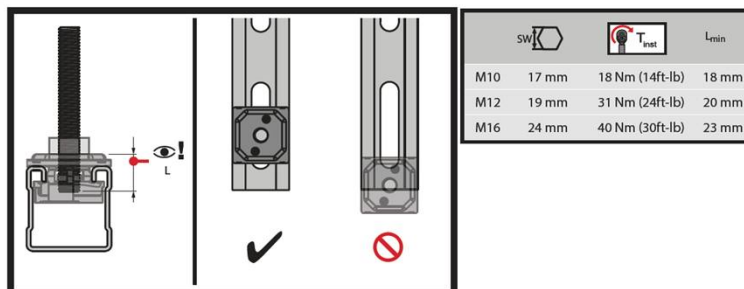
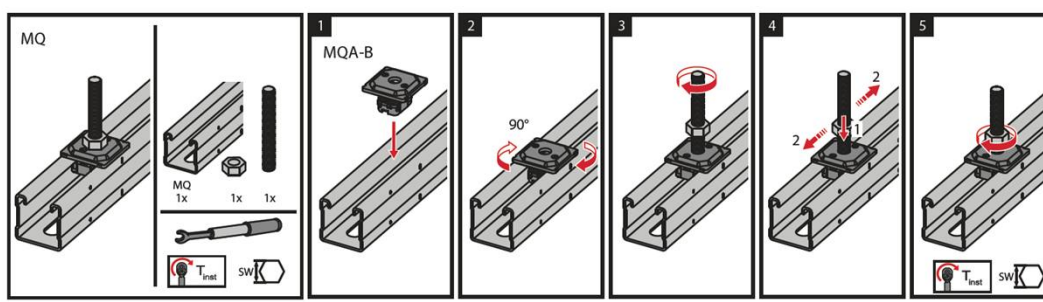
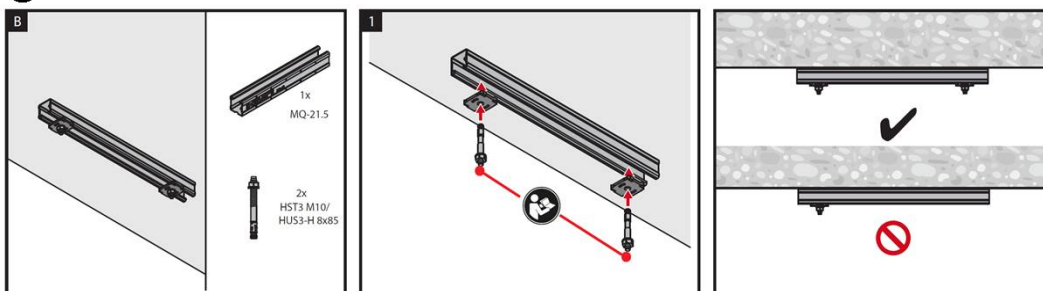
English translation prepared by DIBt

Assembly Instructions / Montagehinweise

1

Please use the Threaded rod & Anchors either in closed long holes or closed round holes in the channel
Verwendung von Gewindestangen & Dübeln nur durch geschlossene Langlöcher bzw. Rundlöcher der Schiene

3



Hilti installation channel MQ-41/3, MQ-41/3 LL, MQ-21.5, MQ-41 and MQ-41-L

General installation instructions
Headrail with Hilti MQ-41/3, MQ-41/3 LL, MQ-41, MQ-41-L and MQ-21.5

Annex E10
(informative)